



Austrian Institute of Construction Engineering
Schenkenstrasse 4 | T+43 1 533 65 50
1010 Vienna | Austria | F+43 1 533 64 23
www.oib.or.at | mail@oib.or.at



European Technical Assessment

ETA-13/0516
of 31.03.2026

General part

**Technical Assessment Body issuing the
European Technical Assessment**

Österreichisches Institut für Bautechnik (OIB)
Austrian Institute of Construction Engineering

Trade name of the construction product

Hilti Firestop Cable Transit CFS-T

**Product family to which the construction
product belongs**

Fire Stopping and Fire Sealing Products:
Penetration Seals

Manufacturer

Hilti AG
Feldkircherstrasse 100
9494 Schaan
LIECHTENSTEIN

Manufacturing plant

Hilti production plant 5
Hilti production plant 25
Hilti production plant 32

**This European Technical Assessment
contains**

83 pages including Annexes A to D which form
an integral part of this assessment.

**This European Technical Assessment
is issued in accordance with Article 95(4)
of Regulation (EU) 2024/3110, on the basis
of**

European Assessment Document
EAD 350454-00-1104 "Fire stopping and fire
sealing products – Penetration seals"

**This European Technical Assessment
replaces**

European Technical Assessment ETA-13/0516 of
04.11.2022

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction can be made with the written consent of the Österreichisches Institut für Bautechnik. Any partial reproduction has to be identified as such.

Content

1	Technical description of the product.....	5
2	Specification of the intended use(s) in accordance with the applicable European Assessment Document (hereinafter EAD)	6
2.1	Intended use	6
2.2	Use condition	7
2.3	Working life	7
2.4	General assumptions	7
2.5	Manufacturing	8
3	Performance of the product and references to the methods used for its assessment	9
3.1	Safety in case of fire (BWR 2)	9
3.2	Hygiene, health and the environment (BWR 3)	10
3.3	Safety and accessibility in use (BWR 4)	10
3.4	Protection against noise (BWR 5)	11
3.5	Energy economy and heat retention (BWR 6)	11
4	Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base	12
5	Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD	13
	ANNEX A - REFERENCE DOCUMENTS	14
	ANNEX B - DESCRIPTION OF THE PRODUCT(S) AND ANCILLARY PRODUCT(S)	15
B.1	Product: SB series	18
B.2	Product: SBO series	19
B.3	Product: SBF-Series	21
B.4	Product: SBS series	24
B.5	Product: SBSO series	25
B.6	Product: RR series	26
B.7	Product: RR series + SLF series	27
B.8	Product: RRS series	30
B.9	Product: RRS series + SLF series	31
B.10	Product: RR Vario series	34
B.11	Product: RR Vario series + SST series	34
B.12	Product: RR Vario (H) series	36
B.13	Product: RR3 series	37
B.14	Product: RR3 series + SLF series	38
B.15	Insulation material	40
B.16	Smoke tightness	42

ANNEX C - RESISTANCE TO FIRE CLASSIFICATION OF PENETRATION SEALS43

C.1 General Information43

C.2 Penetration seal system Hilti CFS-T SB and CFS-T SBO in rigid walls and floors.....44

C.3 Penetration seal system Hilti CFS-T SBF in rigid walls and floors51

C.4 Penetration seal system Hilti CFS-T SBS and CFS-T SBSO in rigid walls and floors58

C.5 Penetration seal system Hilti CFS-T RR and CFS-T RRS in rigid walls and floors61

C.6 Penetration seal system Hilti CFS-T RR Vario in rigid walls and floors.....73

C.7 Penetration seal system Hilti CFS-T RR Vario (H) in rigid walls and floors77

C.8 Penetration seal system Hilti CFS-T RR3 in rigid walls and floors79

ANNEX D - ABBREVIATIONS USED IN DRAWINGS83

Specific parts

1 Technical description of the product

“Hilti Firestop Cable Transit CFS-T” is a kit to be used as a cable- and/or pipe penetration seal (mixed penetration seal) and is designed as a modular system, based on the following components:

Components of “Hilti Firestop Cable Transit CFS-T”	Characteristics
Frames for rectangular openings	made of electrolytical galvanised steel / hot dip galvanised steel / stainless steel; SB Frame (cast in) as single or multiple frame or SBO Frame (surface mounted) as single or multiple frame; the SB, SBO or SBF frames are available as single frame in minimum sizes from 120 x 101 mm (CFS-T SB 2x1 or CFS-T SBO 2x1 or CFS-T SBF 2x1) up to multiple frame in a maximum size of 504 x 562 mm (CFS-T SB 8+8x4 or CFS-T SBO 8+8x4 or CFS-T SBF 8+8+8x10); the SBS or SBSO frames are available as single frame in minimum sizes from 190 x 230 mm (CFS-T SBS 4x1 or CFS-T SBSO 4x1) up to a maximum size of 595 x 347 mm (CFS-T SBS 8x4 and CFS-T SBSO 8x4) and a maximum size of 582 x 262 mm (CFS-T SBS 8+8x2 and CFS-T SBSO 8+8x2); for details see Annex B of the ETA
Frames for circular openings	made of mild steel primed (MSP) / stainless steel; SLF Frame (surface mounted) as single frame; available in sizes from Ø 50 mm to Ø 200 mm, for details see Annex B of the ETA
Plug seals	circular plug seals (CFS-T RR, CFS-T RRS, CFS-T RR Vario, CFS-T RR Vario (H), CFS-T RR3) made of elastomeric rubber with bolts and fittings made of galvanised steel / stainless steel; for details see Annex B of the ETA
Cable transit modules	consists of halogen free elastomeric rubber (HFE); available in different sizes depending on the individual penetration seal diameters; for more details see Annex B of the ETA
Filler blocks	block shaped product based on EPDM rubber material; available in different sizes depending on the individual penetration seal diameters; for more details see Annex B of the ETA
Compression unit	consists of a wedge seal (made of galvanised steel / stainless steel), anchor plates made of galvanised steel / stainless steel) and a lubricant; for more details see Annex B of the ETA

Components of "Hilti Firestop Cable Transit CFS-T"	Characteristics
Sealing strip	CFS-T SST is intended to be used to reduce the annular gap between Hilti CFS-T RR Vario, Hilti CFS-T RR Vario (H), Hilti CFS-T RR3 and the supporting construction. A Nominal 60 mm wide by 1 or 4 mm thick sealing strip may be wrapped around the outer periphery of the EPDM core before installing the Plug Seal (CFS-T RR Vario / (H) or CFS-T RR3) within the opening; for details see Annex B of the ETA.

2 Specification of the intended use(s) in accordance with the applicable European Assessment Document (hereinafter EAD)

2.1 Intended use

"Hilti Firestop Cable Transit CFS-T" is intended to be used as a cable- and / or pipe penetration seal (mixed penetration seal) to temporarily or permanently reinstate the fire resistance performance of rigid wall constructions and rigid floor constructions where they have been provided with apertures which are penetrated by various cables, conduits, metal pipes, plastic pipes and multi-layer composite pipes. Other parts or service support constructions shall not penetrate the penetration seal. Further details are given in Annex C of the ETA.

The maximum opening size of the penetration seal in walls is 504 mm x 562 mm. For more details see Annex C of the ETA.

"Hilti Firestop Cable Transit CFS-T" can be installed only in the types of separating elements as specified in the following table.

Separating element	Construction
Rigid walls	> Concrete > Minimum density 450 kg/m³ (RR Vario, RR Vario (H), RR3) > Minimum density 550 kg/m³ (RR, RRS) > Minimum density 2200 kg/m³ (SB, SBO, SBF, SBS, SBSO) > Minimum thickness 150 mm (SB, SBO, SBF, RR, RRS) > Minimum thickness 200 mm (SBS, SBSO, RR Vario, RR Vario (H), RR3) > The rigid wall shall be classified in accordance with EN 13501-2 for the required fire resistance period
Rigid floors	> Concrete > Minimum density 650 kg/m³ (RR Vario, RR Vario (H), RR3) > Minimum density 2200 kg/m³ (SB, SBO, SBF, SBS, SBSO, RR, RRS) > Minimum thickness 150 mm (SBS, SBSO) > Minimum thickness 200 mm (SB, SBO, SBF, RR, RRS, RR Vario, RR Vario (H), RR3) > The rigid floor shall be classified in accordance with EN 13501-2 for the required fire resistance period

2.2 Use condition

“Hilti Firestop Cable Transit CFS-T” is intended for external use with exposure to rain and UV and can therefore – according to EAD 350454-00-1104 clause 2.2.9.3.1 – be categorized as Type X. Since the requirements for Type X are met, also the requirements for Type Y₁, Y₂, Z₁ and Z₂ are fulfilled.

2.3 Working life

The provisions made in this European Technical Assessment are based on an assumed working life of “Hilti Firestop Cable Transit CFS-T” of 25 years, provided the conditions laid down in the technical literature of the manufacturer relating to packaging, transport, storage, installation, use and repair are met.

The indications given on the intended working life cannot be interpreted as a guarantee given by the producer or the Technical Assessment Body, but are to be regarded only as a means for selecting the appropriate product in relation to the expected economically reasonable working life of the works.

The real working life might be, in normal use conditions, considerably longer without major degradation affecting the Basic requirements for construction works.

2.4 General assumptions

It is assumed that

- damages to the penetration seal are repaired accordingly,
- the installation of the penetration seal does not affect the stability of the adjacent building element – even in case of fire,
- the lintel or floor above the penetration seal is designed structurally and in terms of fire protection such that no additional mechanical load (other than its own weight) is imposed on the penetration seal,
- the installations are fixed to the adjacent building element in accordance with the relevant regulations in such a way that, in case of fire, no additional mechanical load is imposed to the penetration seal,
- the support of the installations is maintained for the required period of fire resistance and
- pneumatic dispatch systems, compressed air systems, etc. are switched off by additional means in case of fire.

2.4.1 This European Technical Assessment does not address any risks associated with the emission of dangerous liquids or gases caused by failure of the pipe(s) in case of fire nor does it prove the prevention of the transmission of fire through heat transfer via the medium in the pipes.

2.4.2 This European Technical Assessment does not verify the prevention of destruction of adjacent building elements with fire separating function or of the pipes themselves due to distortion forces caused by extreme temperatures. These risks shall be accounted for by taking appropriate measures when designing or installing the pipe work.

The mounting or hanging of the pipes or the layout of the pipe work shall be implemented in such a way that the pipes and the fire resistant building elements shall remain functional within a period of time which corresponds to the fire resistance period required.

2.4.3 The risk of downward spread of fire caused by burning material which drips through a pipe to floors below, is not considered in this European Technical Assessment.

2.4.4 The durability assessment does not take account of the possible effect on the penetration seal of substances permeating through the pipe walls.

- 2.4.5 The assessment does not cover the avoidance of destruction of the penetration seal or of the adjacent building element(s) by forces caused by temperature changes in case of fire. This has to be considered when designing the piping system.

2.5 **Manufacturing**

The European Technical Assessment is issued for the product on the basis of agreed data / information, deposited with the Österreichisches Institut für Bautechnik, which identifies the product that has been assessed and judged. Changes to the product or production process, which could result in this deposited data / information being incorrect, should be notified to the Österreichisches Institut für Bautechnik before the changes are introduced.

The Österreichisches Institut für Bautechnik will decide whether or not such changes affect the European Technical Assessment and consequently the validity of the CE marking on the basis of the European Technical Assessment and if so whether further assessment or alterations to the European Technical Assessment, shall be necessary.

3 Performance of the product and references to the methods used for its assessment

Essential characteristic	Method of assessment	Performance
Basic requirement for construction works 2: Safety in case of fire		
Reaction to fire	EN 13501-1: 2007+A1:2009	Clause 3.1.1
Resistance to fire	EN 13501-2: 2007+A1:2009 / EN 13501-2:2016	Clause 3.1.2 and Annex C.1 to C.8
Basic requirement for construction works 3: Hygiene, health and environment		
Air permeability	EN 1026:2000	Clause 3.2.1
Water permeability	Annex C of EAD 350454-00-1104	Clause 3.2.2
Content, emission and/or release of dangerous substances	EN 16516:2020	Clause 3.2.3
Basic requirement for construction works 4: Safety and accessibility in use		
Mechanical resistance and stability	EOTA TR001	Clause 3.3.1
Resistance to impact / movement	EOTA TR001	Clause 3.3.2
Adhesion	No performance assessed	
Durability	EAD 350454-00-1104 clause 2.2.9	Clause 3.3.4
Basic requirement for construction works 5: Protection against noise		
Airborne sound insulation	No performance assessed	
Basic requirement for construction works 6: Energy economy and heat retention		
Thermal properties	No performance assessed	
Water vapour permeability	No performance assessed	

3.1 Safety in case of fire (BWR 2)

3.1.1 Reaction to fire

The components of "Hilti Firestop Cable Transit CFS-T" were assessed according to EAD 350454-00-1104 clause 2.2.1 and classified according to EN 13501-1:2007+A1:2009. The reaction to fire classification of "Hilti Firestop Cable Transit CFS-T" is "E".

3.1.2 Resistance to fire

"Hilti Firestop Cable Transit CFS-T" was tested according to EAD 350454-00-1104 clause 2.2.2, EN 1363-1, EN 1366-3:2009 and EN 1366-3:2021.

Based upon the gained test results and the field of application specified within EN 1363-1, EN 1366-3:2009 and EN 1366-3:2021 the penetration seal "Hilti Firestop Cable Transit CFS-T" has been classified according to EN 13501-2:2016. The individual fire resistance classes are listed in Annex C.1 to C.8 of the ETA.

The maximum fire resistance class of the penetration seal in vertical or horizontal separating element depends on the fire resistance class of the penetrating elements. The fire resistance class of the penetration seal is reduced to the fire resistance class of the penetrating element with the lowest fire resistance classification.

The classifications are not valid for sandwich panel constructions.

3.2 Hygiene, health and the environment (BWR 3)

3.2.1 Air permeability

The air permeability of "Hilti Firestop Cable Transit CFS-T" was tested as a blank penetration seal according to EAD 350454-00-1104 clause 2.2.3 under application of the test principles of EN 1026.

Pressure [Pa]	50	100	150	200	250	300	450	600
q/A air [m ³ /(h·m ²)]	impermeable							

3.2.2 Water permeability

The water permeability of "Hilti Firestop Cable Transit CFS-T" has been tested according to Annex C of EAD 350454-00-1104. Test result: Water tight to 1000 mm (SB-SBO single window-SBF-SBS-SBSO) and 10000 mm (RR Vario-RR3) head of water.

3.2.3 Content, emission and/or release of dangerous substances

The content of semi-volatile organic compounds (SVOC) and volatile organic compounds (VOC) in "Hilti Firestop Cable Transit CFS-T" is assessed according to EN 16516. The loading factor for emission testing was 0,007 m²/m³ according to EAD 350141-00-1106.

The concentration of total emission of SVOC after 3 days was less than 0,005 mg/m³, after 28 days the concentration was less than 0,005 mg/m³. The concentration of total emission of VOC after 3 days was 0,021 mg/m³, after 28 days the concentration was 0,012 mg/m³.

3.3 Safety and accessibility in use (BWR 4)

3.3.1 Mechanical resistance and stability

See clause 3.3.2 below.

3.3.2 Resistance to impact / movement

In impact tests according to EOTA TR001 the requirements for the highest risk zone type (Type IV) have been fulfilled as defined for internal walls in EOTA TR 001 A.1 for:

- Safety in use/Internal Walls (500 Nm soft body impact, 10 Nm hard body impact)
- Serviceability/Internal Walls (120 Nm soft body impact, 6 Nm hard body impact)
- Safety in use/Roofs/Ceilings (1200 Nm soft body impact, 10 Nm hard body impact)
- Serviceability/Roofs/Ceilings (1200 Nm soft body impact, 6 Nm hard body impact)
- Safety in use/Floors (1200 Nm soft body impact, 10 Nm hard body impact)
- Serviceability/Floors (1200 Nm soft body impact, 6 Nm hard body impact)

3.3.3 Adhesion

No performance assessed.

3.3.4 Durability

All components of “Hilti Firestop Cable Transit CFS-T” fulfil the requirements for the intended use category.

“Hilti Firestop Cable Transit CFS-T” is therefore appropriate for use in conditions exposed to weathering with exposure to UV and rain and can – according to EAD 350454-00-1104 clause 2.2.9.3.1 – be categorized as Type X. Since the requirements for Type X are met, also the requirements for Type Y₁, Y₂, Z₁ and Z₂ are fulfilled.

3.4 Protection against noise (BWR 5)

3.4.1 Airborne sound insulation

No performance assessed.

3.5 Energy economy and heat retention (BWR 6)

3.5.1 Thermal properties

No performance assessed.

3.5.2 Water vapour permeability

No performance assessed.

According to the Decision 1999/454/EC¹, amended by Decision 2001/596/EC² of the European Commission the system(s) of assessment and verification of constancy of performance (see Annex V of Regulation (EU) No 305/2011) is given in the following table.

Product(s)	Intended use(s)	Level(s) or class(es) (resistance to fire)	System of assessment and verification of constancy of performance
Fire Stopping and Fire Sealing Products	for fire compartmentation and/or fire protection or fire performance	any	1

In addition, according to the Decision 1999/454/EC, amended by Decision 2001/596/EC of the European Commission the system(s) of assessment and verification of constancy of performance, with regard to reaction to fire, is given the following table.

Product(s)	Intended use(s)	Level(s) or class(es) (reaction to fire)	System of assessment and verification of constancy of performance
Fire Stopping and Fire Sealing Products	For uses subject to regulations on reaction to fire	A1*, A2*, B*, C*	1
		A1**, A2**, B**, C**, D, E	3
		(A1 to E)***, F	4
* Products/materials for which a clearly identifiable stage in the production process results in an improvement of the reaction to fire classification (e.g. an addition of fire retardants or a limiting of organic material) ** Products/materials not covered by footnote (*) *** Products/materials that do not require to be tested for reaction to fire (e.g. products/materials of class A1 according to Commission Decision 96/603/EC, as amended)			

¹ Official Journal of the European Communities no. L 178, 14.7.1999, p. 52

² Official Journal of the European Communities no. L 209, 2.8.2001, p. 33

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with the Technical Assessment Body Österreichisches Institut für Bautechnik.

The notified product certification body shall visit the factory at least twice a year for surveillance of the manufacturer.

Issued in Vienna on 31.03.2026
by Österreichisches Institut für Bautechnik

The original document is signed by:

Thomas Rockenschaub
Managing Director

ANNEX A - REFERENCE DOCUMENTS

A.1 References to standards mentioned in the ETA

EN 1026	Windows and doors – Air permeability – Test method
EN 1363-1	Fire resistance tests – Part 1: General Requirements
EN 1366-3	Fire resistance tests for service installations - Part 3: Penetration seals
EN 13501-1	Fire classification of construction products and building elements – Part 1: Classification using test data from reaction to fire tests
EN 13501-2	Fire classification of construction products and building elements – Part 2: Classification using test data from fire resistance tests
EN 14303	Thermal insulation products for building equipment and industrial installations – Factory made mineral wool (MW) products – Specification
EN 16516	Construction products: Assessment of release of dangerous substances - Determination of emissions into indoor air

A.2 Other reference documents

EOTA TR 001	Determination of impact resistance of panels and panel assemblies
EOTA TR 024	Characterisation, Aspects of Durability and Factory Production Control for Reactive Materials, Components and Products

ANNEX B - DESCRIPTION OF THE PRODUCT(S) AND ANCILLARY PRODUCT(S)

Table B.1 - Frames:

System component	Type element (min-max)	Frame range outer dimension (min-max, mm)	Recommended opening size (Ø, mm)
Frame SB	Single: min. CFS-T SB 2x1 max. CFS-T SB 8x1 Multiple: min. CFS-T SB 4x2 max. CFS-T SB 8+8x4	181x240 – 357x240 240x368 – 624x642	120x101 – 120x277 248x160 – 504x562
Frame SBO	Single: min. CFS-T SBO 2x1 max. CFS-T SBO 8x1 Multiple: min. CFS-T SBO 4x2 max. CFS-T SBO 8+8x4	181x240 – 357x240 240x368 – 624x642	120x101 – 120x277 248x160 – 504x562
Frame SBF	Single: min. CFS-T SBF 2x1 max. CFS-T SBF 8x1 Multiple: min. CFS-T SBF 4x2 max. CFS-T SBF 8+8x4	232x251 – 408x251 291x379 – 693x635	120x101 – 120x277 248x160 – 504x562
Frame SBF with CFS-BL	Single: min. CFS-T SBF 2x1 max. CFS-T SBF 8x1 Multiple: min. CFS-T SBF 4x2 max. CFS-T SBF 8+8+8x10	232x251 – 408x251 291x379 – 978x1403	120x101 – 120x277 248x160 – 870x1300
Frame SBS	Single: min. CFS-T SBS 4x1 max. CFS-T SBS 8x1 Multiple: min. CFS-T SBS 4x2 max. CFS-T SBS 8x4 max. CFS-T SBS 8+8x2	190x230 – 190x347 325x230 – 595x347-582x262	Cast in only Cast in only
Frame SBSO	Single: min. CFS-T SBSO 4x1 max. CFS-T SBSO 8x1 Multiple: min. CFS-T SBSO 4x2 max. CFS-T SBSO 8x4 max. CFS-T SBSO 8+8x2	190x230 – 190x347 325x230 – 595x347-582x262	Cast in only Cast in only
Frame SLF	Min.: CFS-T SLF 50 Max.: CFS-T SLF 200	Ø 57 – Ø 219,1	–

Table B.2 - Plug Seals:

System component	Type element (min-max) incl. version EMC or EX (if applicable)	Recommended opening size (Ø, mm)
Plug seals	Min.: CFS-T RR-50 Max.: CFS-T RR-200	Ø 50–51 / Ø 200-205
	Min.: CFS-T RRS-43 Max.: CFS-T RRS-200	Ø 43-45 / Ø 200-205
	Min.: CFS-T RR Vario-60 Max.: CFS-T RR Vario-300	Ø 61-64 / Ø 301-304
	Min.: CFS-T RR Vario (H)-60 Max.: CFS-T RR Vario (H)-300	Ø 61-64 / Ø 301-304
	Min.: CFS-T RR3-150 Max.: CFS-T RR3-200	Ø 151-152 / Ø 201-202

Table B.3 - Modules, Filler blocks:

System component	Type element	Type element (min-max) incl. version EMC or EX (if applicable)
Cable Transit modules	SB, SBO, SBF	Min.: CFS-T 15/0+3-9, CFS-T 20/0+5-12, CFS-T 30/0+13-23, CFS-T 40/0+23-33, CFS-T 60/0+34-51, CFS-T 90/0+52-78, Max.: CFS-T 120/0+79-99
		Min.: CFS-T 15/3, 4, 5, 6, 7, 8, 9, CFS-T 20/4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, CFS-T 30/12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, Max.: CFS-T 40/22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34
	SBS, SBSO	Min.: CFS-T SBS 20/0+5-12, CFS-T SBS 20/0+5-16 CFS-T SBS 2x15/0+3-5 CFS-T SBS 2x15/0+6-7 CFS-T SBS 30/0+13-23 CFS-T SBS 40/0+23-33, CFS-T SBS SM 40/21-33 CFS-T SBS SM 60/33-51 Max.: CFS-T SBS SM 90/52, 53, 54, 55, 56, 57, 58, 59, 60, 61, 62, 63, 64, 65, 66, 67, 68, 69, 70, 71, 72, 73, 74, 75, 76, 77, 78, 79, 80
Filler blocks	SB, SBO, SBF	Min.: CFS-T FB 12x10/0, CFS-T FB 24x5/0 CFS-T FB 15/0, CFS-T FB 20/0, Max.: CFS-T FB 30/0
	SBS, SBSO	Min.: CFS-T FB SBS 12x10/0, CFS-T FB SBS 24x5/0 CFS-T FB SBS 15/0, CFS-T FB SBS 20/0, Max.: CFS-T FB SBS 30/0

Table B.4 - Wedge seals, anchor plates, sealing strips:

System component	Type element	Description incl. version EMC or EX (if applicable)
Wedge seals & Anchor plates	SB, SBO, SBF	CFS-T WD 120 GS (galvanized) CFS-T WD 120 S/S (stainless steel)
Wedge seals	SBS, SBSO	CFS-T WD 120 SBS GS (galvanized) CFS-T WD 120 SBS S/S (stainless steel)
Anchor plate set	SB, SBO, SBF	CFS-T AP 120 GS (galvanized) CFS-T AP 120 S/S (stainless steel) CFS-T LAP 120 GS (galvanized)
	SBS, SBSO	CFS-T LAP SBS 120 GS (galvanized) CFS-T LAP SBS 120 S/S (stainless steel)
Fixing anchor plate set	SB, SBO, SBF	CFS-T FAP 120 S/S (stainless steel)
Sealing strip	RR, RRS, RR Vario, RR Vario (H), RR3	CFS-T SST 60x1x720 HFE (halogen free elastomer) CFS-T SST 60x4x720 HFE (halogen free elastomer)

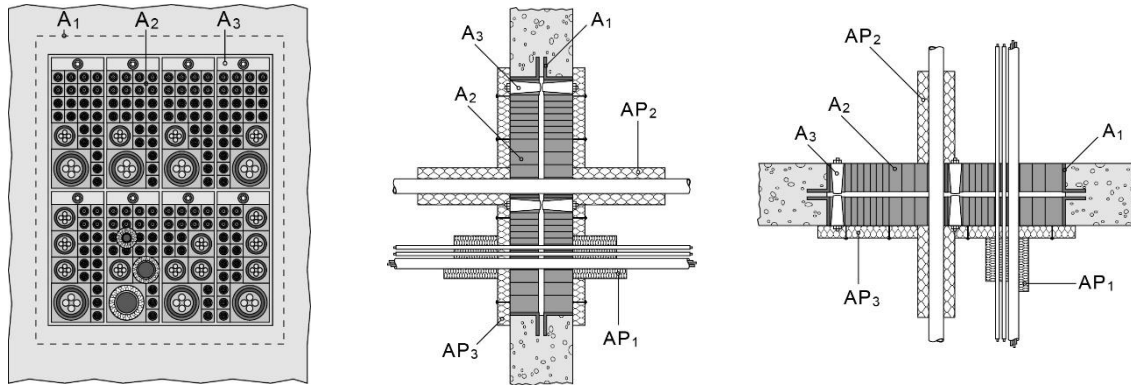
Table B.5 – Additional Firestop Products:

System component	Type element	Description
Firestop Block	CFS-BL	Hilti Firestop Block CFS-BL acc. ETA 13/0099
Firestop Plug	CFS-PL	Hilti Firestop Plug acc. ETA 13/0125
Firestop intumescent Sealing	CFS-FIL	Hilti Firestop Intumescent Sealing CFS-FIL acc. ETA 21/0256

B.1 Product: SB series

B.1.1 System description

The modular system Type “Hilti Firestop Cable Transit CFS-T SB” consists of two cast in flanged steel combination frames installed flush to surface, stone wool insulation, elastomeric rubber modules, wedge compression kit and lubricant.



Frame (A₁):

- Material: electrolytical galvanized steel, Type - Hilti Transit frame CFS-T SB (integrated)
- Max. dimensions: 624 mm x 644 mm x 60 mm (type CFS-T SB 8+8x4)
- Position: casted inside the wall/floor, flush with the surface on both sides of the wall/floor (two frames are placed back to back on an intermediate distance of 30 mm (wall) or 80 mm (floor))

Module (A₂):

- Material: flexible, non-flammable, halogen free elastomeric rubber (HFE)
- Types: See overview in table B.3 of the ETA
Selection according diameter of penetration
- Position: inside the rectangular opening(s) of the frame
- Possible additional parts: core module and filler module used for blank seals and for sealing between cables and basic modules
- Number of modules depending on penetrations

Wedge compression kit (A₃):

- Material: galvanized steel, Type - Hilti CFS-T WD 120 GS wedge compression kit
- Comprising: anchor plates, fixing anchor plate and wedge seal
- Position: inside the rectangular opening(s) of the frame
- Fixed: clamped by tightening the bolt in the wedge seal

Seal insulation:

Cable insulation (AP₁):

- Material: stone wool according Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 30 mm
- Position: insulation on the cables, additional to the seal insulation, on both sides of the wall / on lower side of the floor
- Fixed: with steel gauze (thickness 0,7 mm). Insulation lengths of the cables see Annex C of the ETA

Pipe insulation (AP₂):

- Material: stone wool according Annex B, table B.15.2 of the ETA, thickness see Annex C of the ETA
- Position: insulation on the pipe, additional to the seal insulation, on both sides of the wall / on lower side of the floor
- Insulation lengths of the pipes see Annex C of the ETA

Steel frame insulation (AP₃):

- Material: stone wool according Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 30 mm
- Position: on the seal (including frame if present), on both sides of the wall/ on lower side of the floor
- Fixed: with pins (diameter 4 mm) and washers

B.1.2 Seal size

Range: min. 120 mm x 101 mm (CFS-T SB 2x1) to max. 504 mm x 562 mm (CFS-T SB 8+8x4)

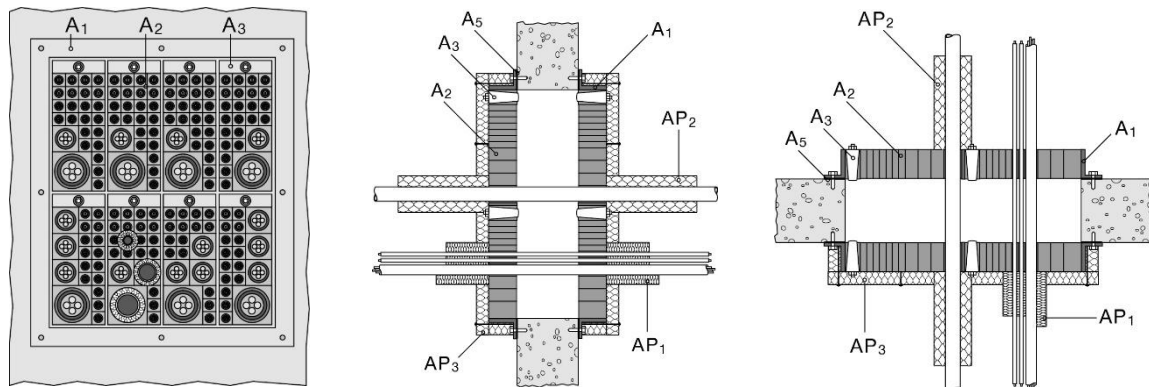
B.1.3 Number of penetrations

Depends on selected frame type, details given in Annex C of the ETA

B.2 Product: SBO series

B.2.1 System description

The modular system Type “Hilti Firestop Cable Transit CFS-T SBO” consists of two surface mounted flanged steel combination frame, stone wool insulation, elastomeric rubber modules, wedge compression kit and lubricant.



Frame (A₁):

- Material: electrolytical galvanized steel, Type - Hilti Transit frame CFS-T SBO (surface mounted)
- Max. dimensions: 624 mm x 644 mm x 60 mm height (type CFS-T SBO 8+8x4)
- Position: surface mounted both sides of the wall/floor
- Fixed: with anchor bolts to the wall/floor

Smoke tightness between frame and support construction according to Annex B.8 of the ETA.

Module (A₂):

- Material: flexible, non-flammable, halogen free elastomeric rubber (HFE)
- Types: See overview in table B.3 of the ETA
Selection according to diameter of penetration
- Position: inside the rectangular opening(s) of the frame
- Possible additional parts: core module and filler module used for blank seals and for sealing between cables and basic modules
- Number of modules depending on penetrations

Wedge compression kit (A₃):

- Material: galvanized steel, Type - Hilti CFS-T WD 120 GS wedge compression kit
- Comprising: anchor plates, fixing anchor plate and wedge seal
- Position: inside the rectangular opening(s) of the frame
- Fixed: clamped by tightening the bolt in the wedge seal

Seal insulation:

Cable insulation (AP₁):

- Material: stone wool according Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 30 mm
- Position: insulation on the cables, additional to the seal insulation, on both sides of the wall / on lower side of the floor
- Fixed: with steel gauze (thickness 0,7 mm). Insulation lengths of the cables see Annex C of the ETA

Pipe insulation (AP₂):

- Material: stone wool according Annex B, table B.15.2 of the ETA, thickness see Annex C of the ETA
- Position: insulation on the pipe, additional to the seal insulation, on both sides of the wall / on lower side of the floor
- Insulation lengths of the pipes see Annex C of the ETA

Steel frame insulation (AP₃):

- Material: stone wool according Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 30 mm
- Position: on the seal (including frame if present), on both sides of the wall / on lower side of the floor
- Fixed: with pins (diameter 4 mm) and washers

B.2.2 Seal size

Range: min. 120 mm x 101 mm (CFS-T SBO 2x1) to max. 504 mm x 562 mm (CFS-T SBO 8+8x4)

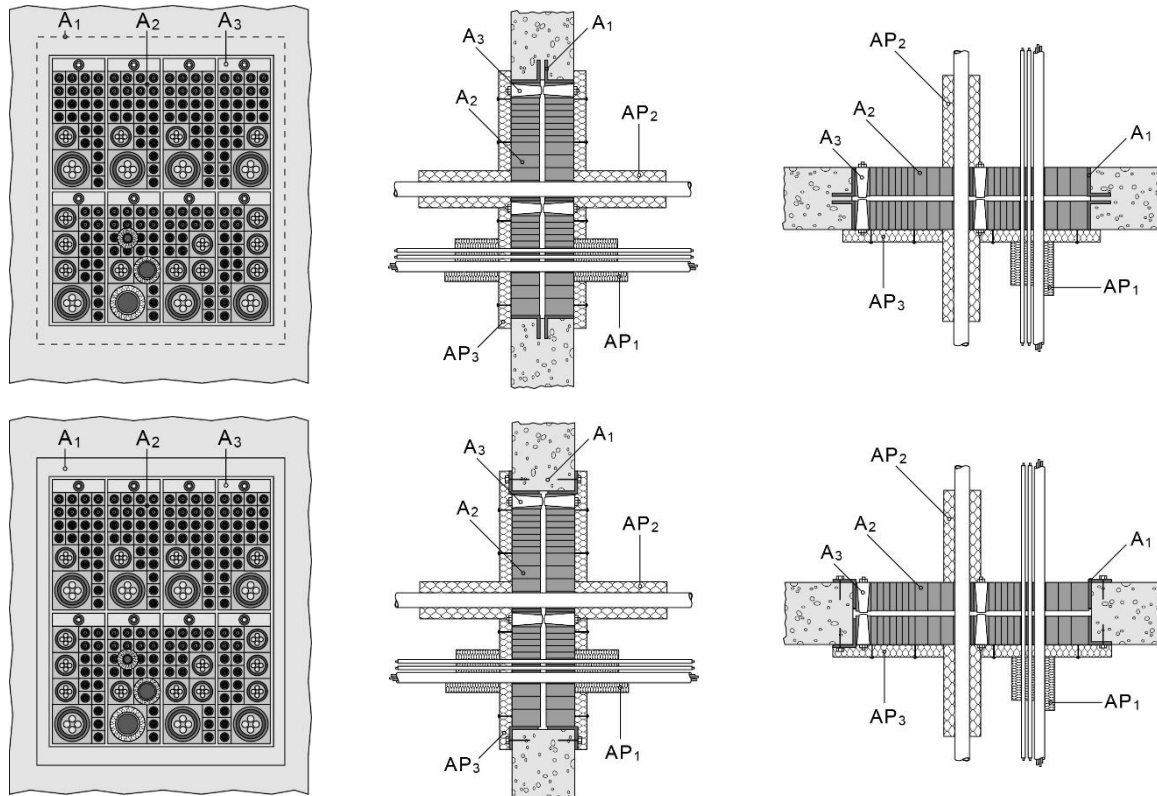
B.2.3 Number of penetrations

Depends on selected frame type, details given in Annex C of the ETA.

B.3 Product: SBF-Series

B.3.1 System description – back to back

The modular system Type “Hilti Firestop Cable Transit CFS-T SBF” consists of two cast in or surface mounted flanged steel combination frame installed flush to surface, stone wool insulation, elastomeric rubber modules, wedge compression kit and lubricant.



Frame (A₁):

- Material: Hot dip galvanized steel, Type - Hilti Transit frame CFS-T SBF (integrated)
- Max. dimensions: 693 mm x 635 mm x 60 mm (type CFS-T SBF 8+8x4)
- Position: casted inside the wall/floor, fixed with metal bolt-/anchor on both sides of the wall/floor (two frames are placed back to back on an intermediate distance of 40 mm (wall) or 90 mm (floor))

Module (A₂):

- Material: flexible, non-flammable, halogen free elastomeric rubber (HFE)
- Types: See overview in table B.3 of the ETA
Selection according to diameter of penetration
- Position: inside the rectangular opening(s) of the frame
- Possible additional parts: core module and filler module used for blank seals and for sealing between cables and basic modules
- Number of modules depending on penetrations

Wedge compression kit (A₃):

- Material: galvanized steel, Type - Hilti CFS-T WD 120 GS wedge compression kit
- Comprising: anchor plates, fixing anchor plate and wedge seal
- Position: inside the rectangular opening(s) of the frame
- Fixed: clamped by tightening the bolt in the wedge seal

Seal insulation:

Cable insulation (AP₁):

- Material: stone wool according Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 30 mm
- Position: insulation on the cables, additional to the seal insulation, on both sides of the wall / on lower side of the floor
- Fixed: with steel gauze (thickness 0,7 mm). Insulation lengths of the cables see Annex C of the ETA

Pipe insulation (AP₂):

- Material: stone wool according Annex B, table B.15.2 of the ETA, thickness see Annex C of the ETA
- Position: insulation on the pipe, additional to the seal insulation, on both sides of the wall / on lower side of the floor
- Insulation lengths of the pipes see Annex C of the ETA

Steel frame insulation (AP₃):

- Material: stone wool according Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 30 mm
- Position: on the seal (including frame if present), on both sides of the wall / on lower side of the floor
- Fixed: with pins (diameter 4 mm) and washers

B.3.1.1 Seal size

Range: min. 120 mm x 101 mm (CFS-T SBF 2x1) to max. 504 mm x 562 mm (CFS-T SBF 8+8x4)

B.3.1.2 Number of penetrations

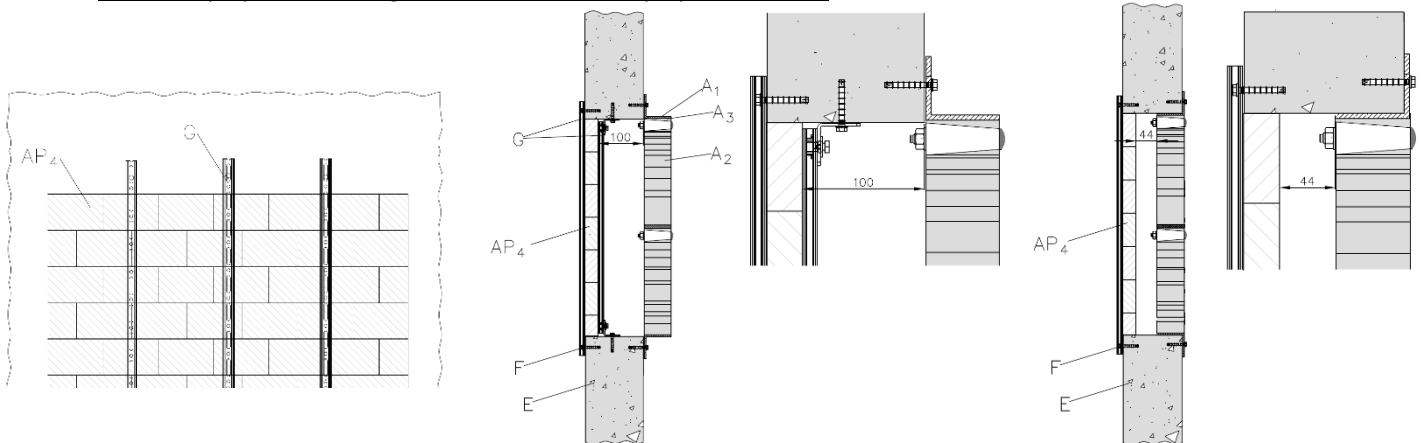
Depends on selected frame type, details given in Annex C of the ETA.

B.3.2 System description – single sided CFS-T SBF + CFS-T and CFS-BL

Frame (A₁): in addition to B.3.1

- Max. dimensions: 978 mm x 1403 mm x 60 mm (type CFS-T SBF 8+8+8x10)
- Position: integrated inside the aperture of the wall alternative face fixed on the wall
- fixed with metal bolt-/anchor (F) on the installation side of the wall – for tightness a thin layer of CFS-S ACR (acc. ETA 10/0389) between transit frame and surface of the supporting construction to apply

Module (A₂): and Wedge compression kit (A₃): see B.3.1



CFS-BL (AP₄):

- Product acc. ETA 13/0099
- Position: inside the aperture in parallel with CFS-T (A₂)
 - With an airgap of ≥ 44 mm from the integrated CFS-T seal
 - With an airgap of ≥ 100 mm from the face fixed CFS-T seal
- Stacked in a staggered manner
- Installed in 50 mm thickness direction
- Fixed by means of friction and pressure between the bricks and aperture edge
- Support (G): Hilti MQ 21.5 mm channels at a c/c distance of ≤ 240 mm
 - Resulting in 3 channels for the maximum seal size of CFS-T SBF 8+8+8x10
 - For the integrated CFS-T seal (airgap 44 mm) only at the outer face of the block seal
 - For the face fixed CFS-T seal (airgap ≥ 100 mm) and the integrated CFS-T seal with an airgap of > 44 mm at both side of the block seal
 - Outer face channels are fixed to the wall with an Anchor at the end
 - Inner channels are fixed with an angle Hilti MQW-2- and an Anchor at each end
- CFS-FIL (acc. ETA 21/0256) to fill gaps (if any) between CFS-BL and the aperture edge and between CFS-BL and the services

Service insulation:

Cable (AP₁) and pipe insulation (AP₂) acc. B.15.3.1 and B.15.4

- Position: insulation on each service, symmetrical on both sides of the wall
- Fixed: mineral wool with steel gauze (min. thickness 0,7 mm); for elastomeric rubber foam insulation with adhesive Armaflex glueing strip. Insulation lengths of the services see Annex C of the ETA.

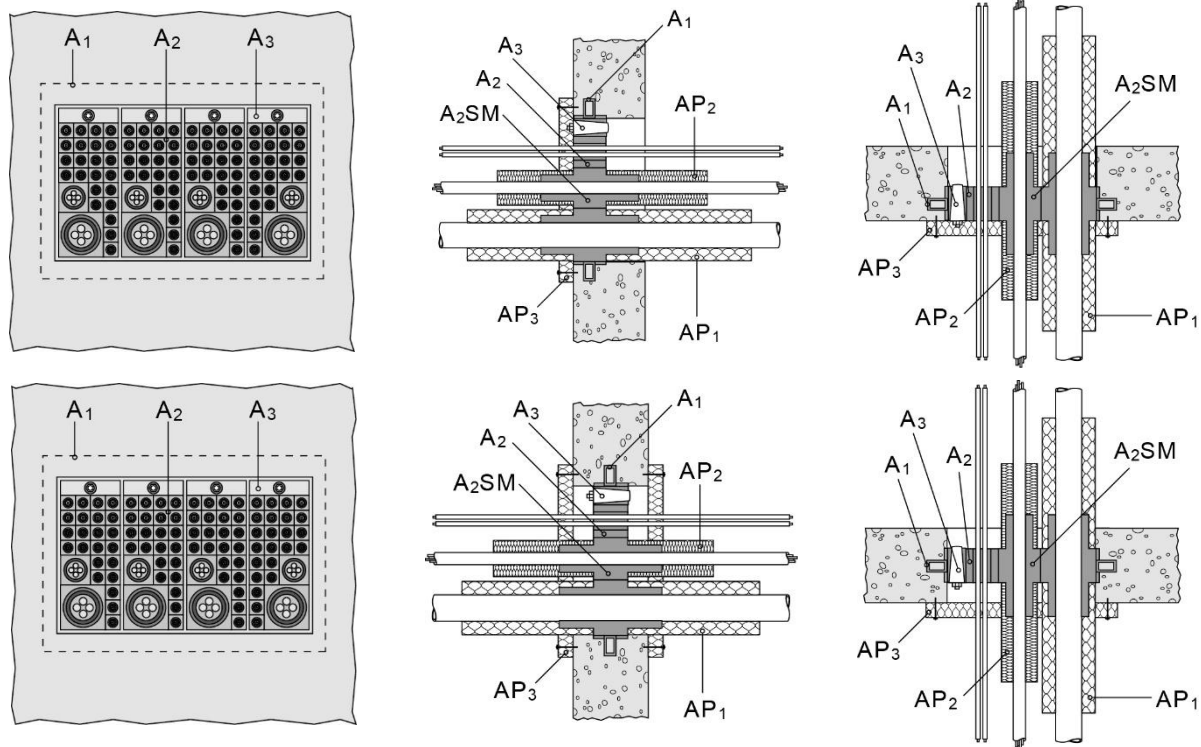
B.3.2.1 Seal size

Range: min. 120 mm x 101 mm (CFS-T SBF 2x1) to max. 870 mm x 1300 mm (CFS-T SBF 8+8+8x10)

B.4 Product: SBS series

B.4.1 System description

The modular system Type "Hilti Firestop Cable Transit CFS-T SBS" consists of one cast in flanged steel combination frame installed flush to surface on one side or integrated in the middle of the wall/floor, stone wool insulation, elastomeric rubber modules, wedge compression kit and lubricant.



Frame (A₁):

- Material: hot dip galvanized steel, Type - Hilti Transit frame CFS-T SBS (cast in)
- Max. dimensions: 595 mm x 347 mm x 90 mm (type CFS-T SBS 8x4)
- Max. dimensions: 582 mm x 262 mm x 90 mm (type CFS-T SBS 8+8x2)
- Position: casted inside the wall/floor, flush with the surface on one side or integrated in the middle of the wall/floor.

Module (A₂):

- Material: flexible, non-flammable, halogen free elastomeric rubber (HFE)
- Types: See overview in table B.3 of the ETA - Selection according to diameter of penetration
- Position: inside the rectangular opening(s) of the frame
- Possible additional parts: core module, super module and filler module used for blank seals and for sealing between cables and basic modules
- Number of modules depending on penetrations

Wedge compression kit (A₃):

- Material: galvanized steel, Type - Hilti CFS-T WD 120 SBS GS, S/S wedge compression kit
- Comprising: anchor plates, wedge seal
- Position: inside the rectangular opening(s) of the frame
- Fixed: clamped by tightening the bolt in the wedge seal

Seal insulation:

Cable insulation (AP₁):

- Super module CFS-T SBS SM in sizes 40, 60 and 90 covering a cable diameter range from 23 up to 80 mm
- For one cable is one module required
- Fixed: with clamps

B.4.2 Seal size

Range: min. 120 mm x 160 mm (CFS-T SBS 4x1) to max. 525 mm x 277 mm (CFS-T SBS 8x4)

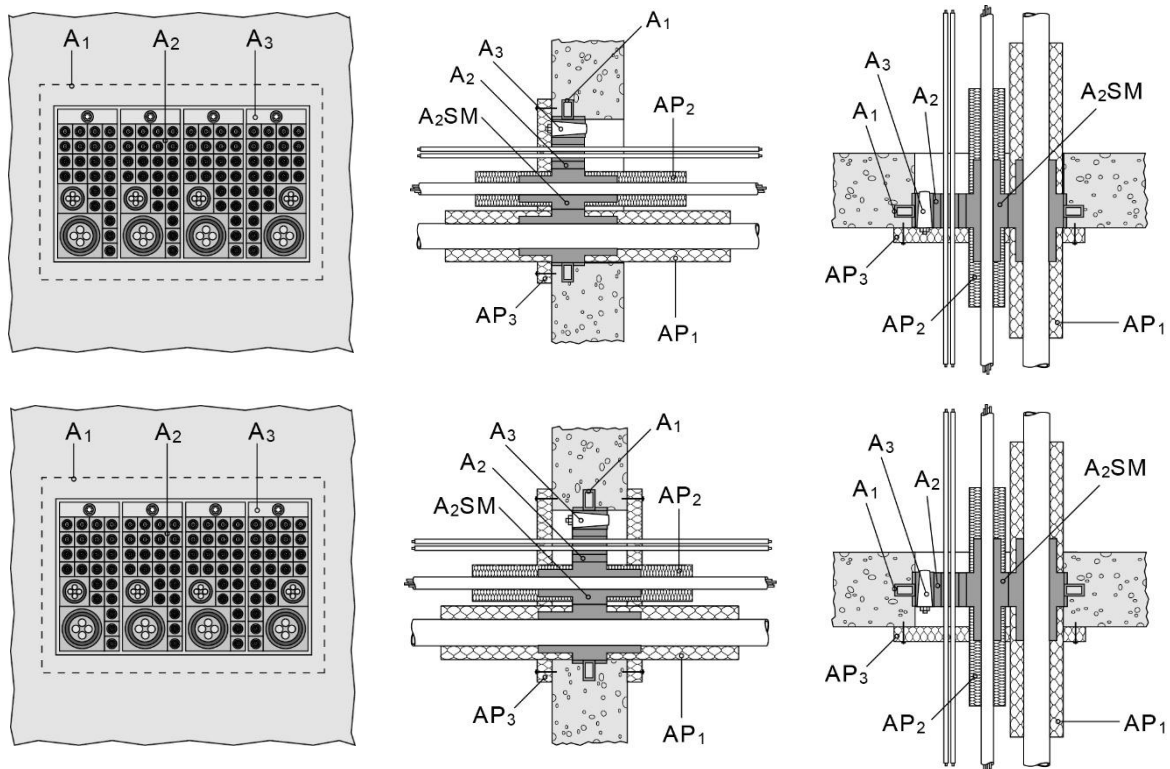
B.4.3 Number of penetrations

Depends on selected frame type, details given in Annex C of the ETA.

B.5 Product: SBSO series

B.5.1 System description

The modular system Type “Hilti Firestop Cable Transit CFS-T SBF” consists of two cast in or surface mounted flanged steel combination frame installed flush to surface, stone wool insulation, elastomeric rubber modules, wedge compression kit and lubricant.



Frame (A₁):

- Material: electrolytical galvanized steel, Type - Hilti Transit frame CFS-T SBSO (cast in)
- Max. dimensions: 595 mm x 347 mm x 90 mm (type CFS-T SBSO 8x4)
- Max. dimensions: 582 mm x 262 mm x 90 mm (type CFS-T SBSO 8+8x2)
- Position: casted inside the wall/floor, flush with the surface on one side or integrated in the middle of the wall/floor.

Module (A₂):

- Material: flexible, non-flammable, halogen free elastomeric rubber (HFE)
- Types: See overview in table B.3 of the ETA
Selection according to diameter of penetration
- Position: inside the rectangular opening(s) of the frame
- Possible additional parts: core module, super module and filler module used for blank seals and for sealing between cables and basic modules
- Number of modules depending on penetrations

Wedge compression kit (A₃):

- Material: galvanized steel, Type - Hilti CFS-T WD 120 SBSO GS, S/S wedge compression kit
- Comprising: anchor plates, wedge seal
- Position: inside the rectangular opening(s) of the frame
- Fixed: clamped by tightening the bolt in the wedge seal

Seal insulation:

Cable insulation (AP₁):

- Super module CFS-T SBS SM in sizes 40, 60 and 90 covering a cable diameter range from 23 up to 80 mm
- For one cable is one module required
- Fixed: with clamps

B.5.2 Seal size

Range: min. 120 mm x 160 mm (CFS-T SBSO 4x1) to max. 525 mm x 277 mm (CFS-T SBSO 8x4)

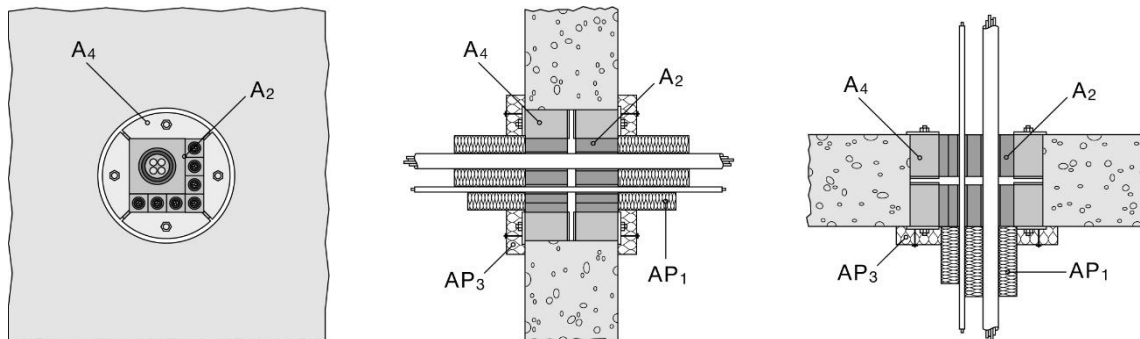
B.5.3 Number of penetrations

Depends on selected frame type, details given in Annex C of the ETA.

B.6 Product: RR series

B.6.1 System description

The modular system Type “Hilti Firestop Cable Transit CFS-T RR” consists of an elastic plug seal, stone wool insulation, elastomeric rubber modules and lubricant.



Plug seal (A₄):

- Material: flexible, non-flammable, halogen free elastomeric rubber (HFE)
- Max. dimensions: Ø 200 mm (type CFS-T RR 200)
- Types: Hilti CFS-T RR-50, CFS-T RR-70, CFS-T RR-100, CFS-T RR-125, CFS-T RR-150, CFS-T RR-200
- Position: inside the opening(s) of the wall/floor
- Fixed: clamped inside the wall/floor opening by tightening the bolts of the clamp plates

Module (A₂):

- Material: flexible, non-flammable, halogen free elastomeric rubber (HFE)
- Types: Hilti CFS-T 15, CFS-T 20, CFS-T 30, CFS-T 40, CFS-T 60, CFS-T 90, Hilti CFS-T FB 15, CFS-T FB 20, CFS-T FB 30
Selection according to diameter of penetration
- Position: inside the rectangular opening(s) of the frame
- Possible additional parts: core module and filler module used for blank seals and for sealing between cables and basic modules
- Number of modules depending on penetrations

Seal insulation:

Cable insulation (AP₁):

- Material: stone wool according to Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 30 mm
- Position: insulation on the cables, additional to the seal insulation, on both sides of the wall / on lower side of the floor
- Fixed: with steel gauze (thickness 0,7 mm). Insulation lengths of the cables see Annex C of the ETA

Plug insulation (AP₃):

- Material: stone wool according to Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 30 mm
- Position: on the plug on both sides of the wall/ on lower side of the floor
- Fixed: with pins (diameter 4 mm) and washers

B.6.2 Seal size

Range: min. Ø 50 mm (CFS-T RR-50) up to max. Ø 205 mm (CFS-T RR-200)

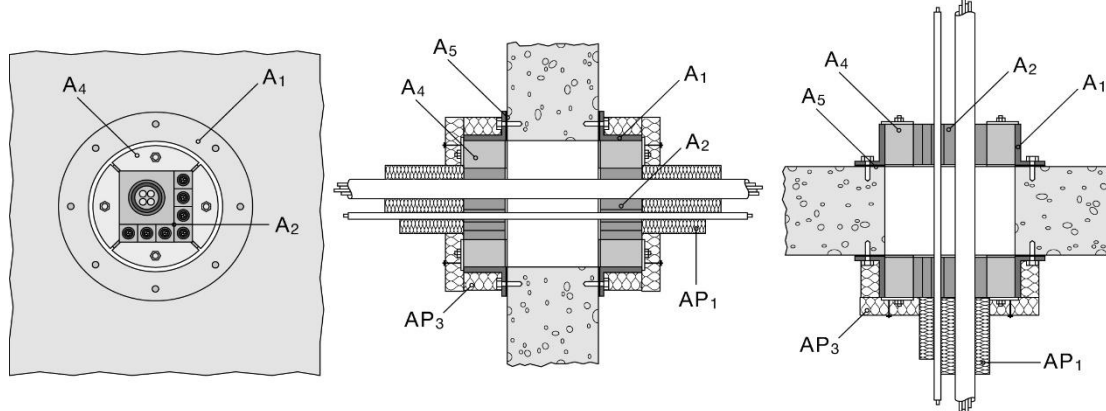
B.6.3 Number of penetrations

Any number of single openings Hilti CFS-T RR-50 up to Hilti CFS-T RR-200, details given in Annex C of the ETA

B.7 Product: RR series + SLF series

B.7.1 System description back to back

The modular system Type “Hilti Firestop Cable Transit CFS-T RR + CFS-T SLF” consists of a flanged steel sleeve, elastic plug seal, stone wool insulation, elastomeric rubber modules and lubricant.



Steel Sleeve (A₁):

- Material: mild steel primed (MSP)
- Max. dimensions: Ø 200 mm (type CFS-T SLF 200)
- Types: Hilti CFS-T SLF 50, CFS-T SLF 70, CFS-T SLF 100, CFS-T SLF 125, CFS-T SLF 150, CFS-T SLF 200 MSP (surface mounted)
- Max. dimensions: outer diameter 320 mm, height 70 mm, thickness 5 mm and 8 mm (type CFS-T SLF 200 MSP)
- Fixed: with 4 anchor bolts to the wall/floor

Smoke tightness between frame and support construction according Annex B.8 of the ETA.

Plug seal (A₄):

- Material: flexible, non-flammable, halogen free elastomeric rubber (HFE)
- Max. dimensions: Ø 200 mm (type CFS-T RR 200)
- Types: Hilti CFS-T RR-50, CFS-T RR-70, CFS-T RR-100, CFS-T RR-125, CFS-T RR-150, CFS-T RR-200
- Position: inside the steel sleeve of the wall/floor
- Fixed: clamped inside the steel sleeve opening by tightening the bolts of the clamp plates

Module (A₂):

- Material: flexible, non-flammable, halogen free elastomeric rubber (HFE)
- Types: Hilti CFS-T 15, CFS-T 20, CFS-T 30, CFS-T 40, CFS-T 60, CFS-T 90, Hilti CFS-T FB 15, CFS-T FB 20, CFS-T FB 30
Selection according to diameter of penetration
- Position: inside the rectangular opening(s) of the frame
- Possible additional parts: core module and filler module used for blank seals and for sealing between cables and basic modules
- Number of modules depending on penetrations

Seal insulation:

Cable insulation (AP₁):

- Material: stone wool according Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 30 mm
- Position: insulation on the cables, additional to the seal insulation, on both sides of the wall / on lower side of the floor
- Fixed: with steel gauze (thickness 0,7 mm). Insulation lengths of the cables see Annex C of the ETA

Steel sleeve insulation (AP₃):

- Material: stone wool according Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 30 mm
- Position: on the steel sleeve on both sides of the wall/ on lower side of the floor
- Fixed: with pins (diameter 4mm), washers and with steel gauze (thickness 0,7 mm)

B.7.1.1 Seal size

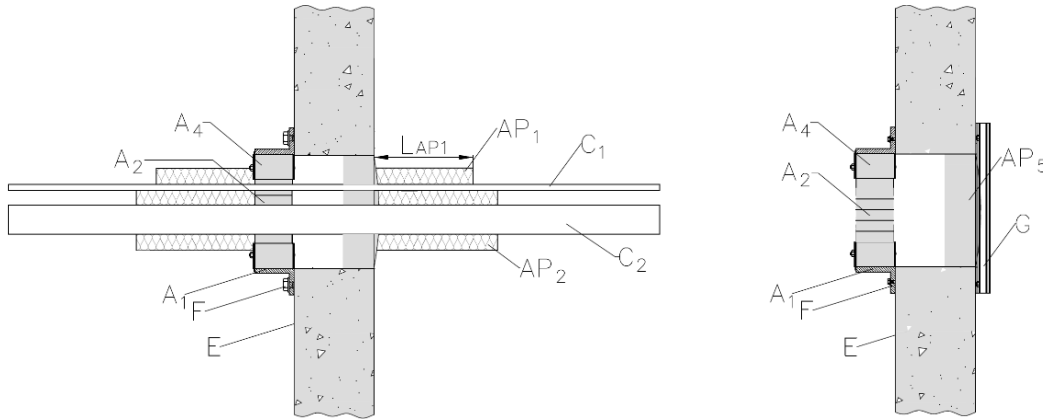
Range: min. Ø 50 mm (CFS-T RR-50) up to max. Ø 205 mm (CFS-T RR-200)

B.7.1.2 Number of penetrations

Any number of single openings CFS-T RR-50 + CFS-T SLF 50 MSP up to CFS-T RR-200 + CFS-T SLF 200 MSP, details given in Annex C of the ETA.

B.7.2 System description single sided with CFS-T RR + CFS-SLF and CFS-PL

The modular system Type “Hilti Firestop Cable Transit CFS-T RR + CFS-T SLF and CFS-PL” consists of a flanged steel sleeve, elastic plug seal, firestop plug, stone wool insulation, elastomeric rubber modules and lubricant.



Steel sleeve acc. B.7.1 (A₁) face fixed on the wall, fixed with metal anchor on one side of the wall, plug seal (A₄) and modules (A₂) acc. B.7.1 ff.

CFS-PL (AP₅):

- Product acc. ETA 13/0125
- Position: inside the aperture in parallel with CFS-T
 - With an airgap of ≥ 90 mm from the face fixed CFS-T seal
 - Support (G): Hilti MQ 21.5 mm channels and two anchors (e.g. Hilti HUS3-H 8x65) – can be omitted by using a penetrating service with a minimum outer diameter of 64 mm (circumference of 201 mm) – this contact surface can be generated by multiple smaller services as well.
- CFS-FIL (acc. ETA 21/0256) to fill gaps (if any) between the plugs and the aperture edge and between CFS-PL and the services

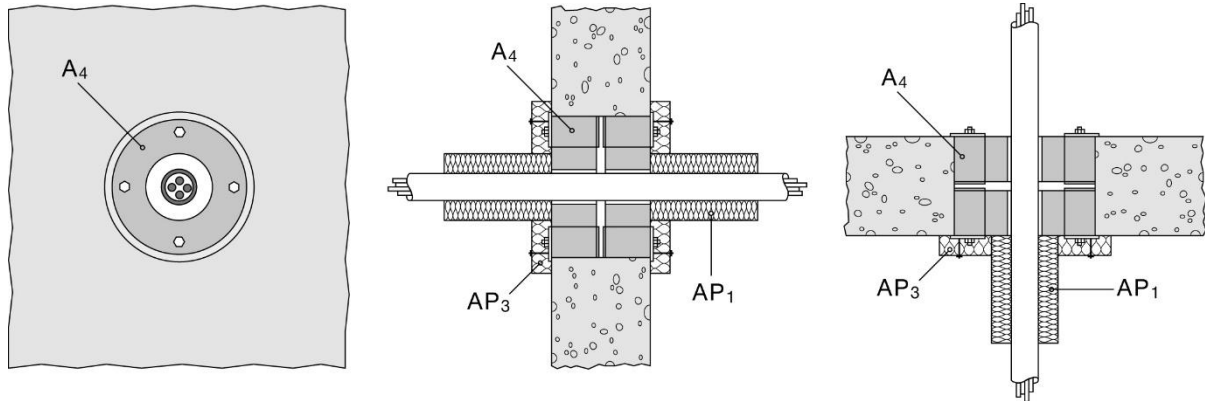
Cable (AP₁) and pipe insulation (AP₂) acc. B.15.3.1 and B.15.4 and C.5.9

- Position: insulation on each service, symmetrical on both sides of the wall
- Fixed: mineral wool with steel gauze (min. thickness 0,7 mm); for elastomeric rubber foam insulation with adhesive Armaflex glueing strip. Insulation lengths of the services see Annex C of the ETA.

B.8 Product: RRS series

B.8.1 System description - back to back

The modular system Type “Hilti Firestop Cable Transit CFS-T RRS” consists of an elastic plug seal, stone wool insulation, elastomeric rubber modules and lubricant.



Plug seal (A₄):

- Material: flexible, non-flammable, halogen free elastomeric rubber (HFE)
- Max. dimensions: Ø 100 mm (type CFS-T RRS 100)
- Types: Hilti CFS-T RRS-43, CFS-T RRS-50, CFS-T RRS-70, CFS-T RRS-100
Selection according to diameter of penetration
- Position: inside the opening(s) of the wall/floor
- Fixed: clamped inside the wall/floor opening by tightening the bolts of the clamp plates
- Adapter Material: flexible, non-flammable, halogen free elastomeric rubber (HFE).
Position: inside the plug seal in order to adjust the cable diameter by using black, grey or red adapter

Seal insulation:

Cable insulation (AP₁):

- Material: stone wool according to Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 30 mm
- Position: insulation on the cables, additional to the seal insulation, on both sides of the wall / on lower side of the floor
- Fixed: with steel gauze (thickness 0,7 mm). Insulation lengths of the cables see Annex C of the ETA

Plug insulation (AP₃):

- Material: stone wool according to Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 30 mm
- Position: on the plug on both sides of the wall/ on lower side of the floor
- Fixed: with pins (diameter 4 mm) and washers

B.8.1.1 Seal size

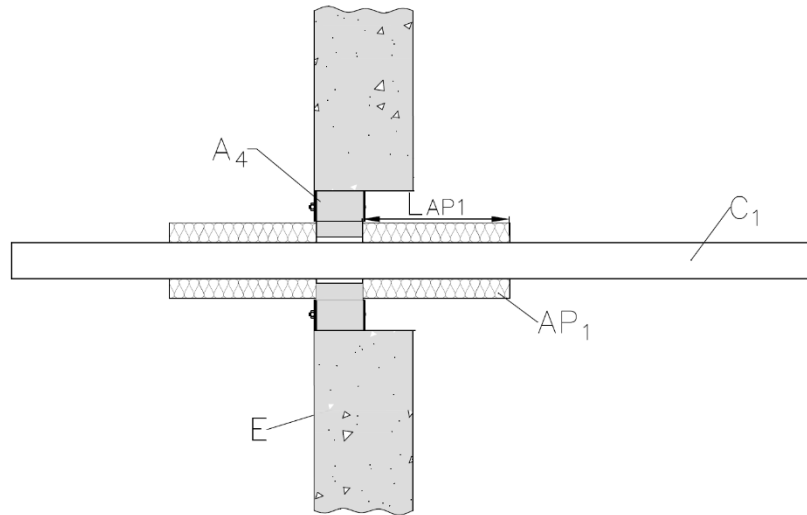
Range: min. Ø 43 mm (CFS-T RRS-43) up to max. Ø 103 mm (CFS-T RRS-100)

B.8.1.2 Number of penetrations

Any number of single openings Hilti CFS-T RRS-43 up to Hilti CFS-T RRS-100, details given in Annex C of the ETA.

B.8.2 System description single sided with CFS-T RRS

The modular system Type “Hilti Firestop Cable Transit CFS-T RRS” consists of an elastic plug seal, stone wool insulation, elastomeric rubber modules and lubricant.



Plug seal (A₄):

- Material: flexible, non-flammable, halogen free elastomeric rubber (HFE)
- Max. dimensions: Ø 200 mm (type CFS-T RRS 200)
- Types: Hilti CFS-T RRS-43, CFS-T RRS-50, CFS-T RRS-70, CFS-T RRS-100, CFS-T RRS 125, CFS-T RRS 150 CFS-T RRS 200
Selection according to diameter of penetration
- Position: inside the opening(s) of the wall
- Fixed: clamped inside the wall opening by tightening the bolts of the clamp plates
- Adapter Material: flexible, non-flammable, halogen free elastomeric rubber (HFE).
Position: inside the plug seal in order to adjust the cable diameter by using black, grey or red adapter

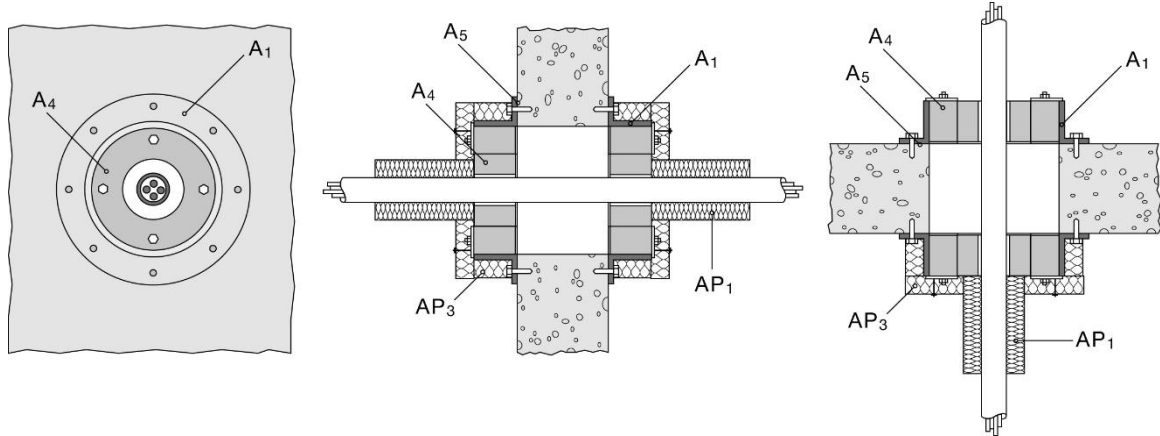
Cable insulation (AP₁) acc. B.15.3.1 and B.15.3.2 and C.5.10.2

- Position: insulation on each service, symmetrical on both sides of the wall
- Fixed: mineral wool with steel gauze (min. thickness 0,7 mm); Insulation lengths of the services see Annex C of the ETA.

B.9 Product: RRS series + SLF series

B.9.1 System description - back to back

The modular system Type “Hilti Firestop Cable Transit CFS-T RRS” consists of a flanged steel sleeve installed both sides, an elastic plug seal, stone wool insulation, elastomeric rubber modules and lubricant.



Steel Sleeve (A₁):

- Material: mild steel primed (MSP)
- Max. dimensions: Ø 100 mm (type CFS-T SLF 100)
- Types: Hilti CFS-T SLF 50, CFS-T SLF 70, CFS-T SLF 100 MSP (surface mounted)
- Max dimensions: outer diameter 208 mm, height 70 mm, thickness 5 mm and 8 mm (type CFS-T SLF 100 MSP)
- Fixed: with 4 anchor bolts to the wall/floor

Smoke tightness between frame and support construction according Annex B.8 of the ETA.

Plug seal (A₄):

- Material: flexible, non-flammable, halogen free elastomeric rubber (HFE)
- Max. dimensions: Ø 100 mm (type CFS-T RRS 100)
- Types: Hilti CFS-T RRS-43, CFS-T RRS-50, CFS-T RRS-70, CFS-T RRS-100
Selection according to diameter of penetration
- Position: inside the steel sleeve of the wall/floor
- Fixed: clamped inside the steel sleeve opening by tightening the bolts of the clamp plates
- Adapter Material: flexible, non-flammable, halogen free elastomeric rubber (HFE).
Position: inside the plug seal to adjust the cable diameter by using black, grey or red adapter

Seal insulation:

Cable insulation (AP₁):

- Material: stone wool according Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 30 mm
- Position: insulation on the cables, additional to the seal insulation, on both sides of the wall/ on lower side of the floor
- Fixed: with steel gauze (thickness 0,7 mm). Insulation lengths of the cables see Annex C of the ETA to adjust the cable diameter by using black, grey or red adapter

Steel sleeve insulation (AP₃):

- Material: stone wool according Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 30 mm
- Position: on the steel sleeve on both sides of the wall/ on lower side of the floor
- Fixed: with pins (diameter 4 mm), washers and with steel gauze (thickness 0,7 mm)

B.9.1.1 Seal size

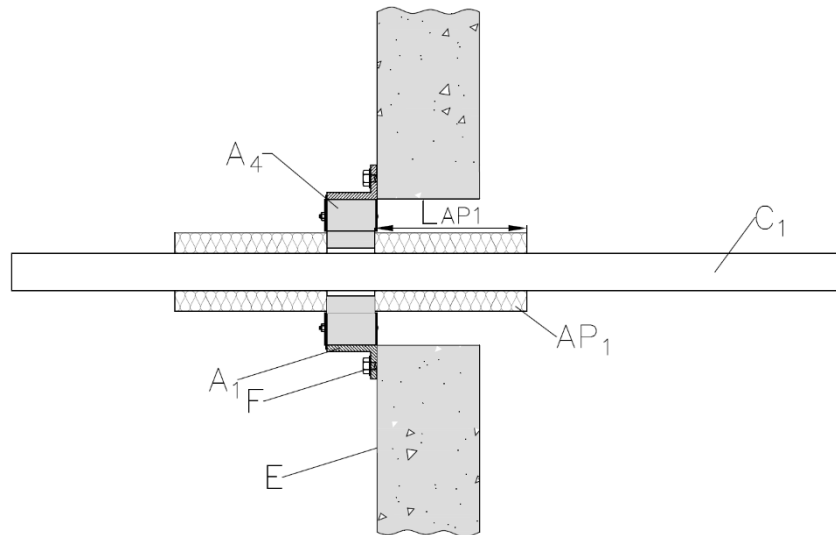
Range: min. Ø 43 mm (CFS-T RRS-43) up to max. Ø 103 mm (CFS-T RRS-100)

B.9.1.2 Number of penetrations

Any number of single openings Hilti CFS-T RRS-43 up to Hilti CFS-T RRS-100, details given in Annex C of the ETA

B.9.2 System description single sided with CFS-T RRS + CFS-SLF - face fixed

The modular system Type “Hilti Firestop Cable Transit CFS-T RRS” consists of a flanged steel sleeve installed single sided, an elastic plug seal, stone wool insulation, elastomeric rubber modules and lubricant.



Steel sleeve acc. B.9.1 (A_1) face fixed on the wall, fixed with metal bolt-/anchor on one side of the wall, plug seal (A_4) acc. B.9.1 ff.

- Types: Hilti CFS-T SLF 50 mm, CFS-T SLF 70 mm, CFS-T SLF 100 mm,

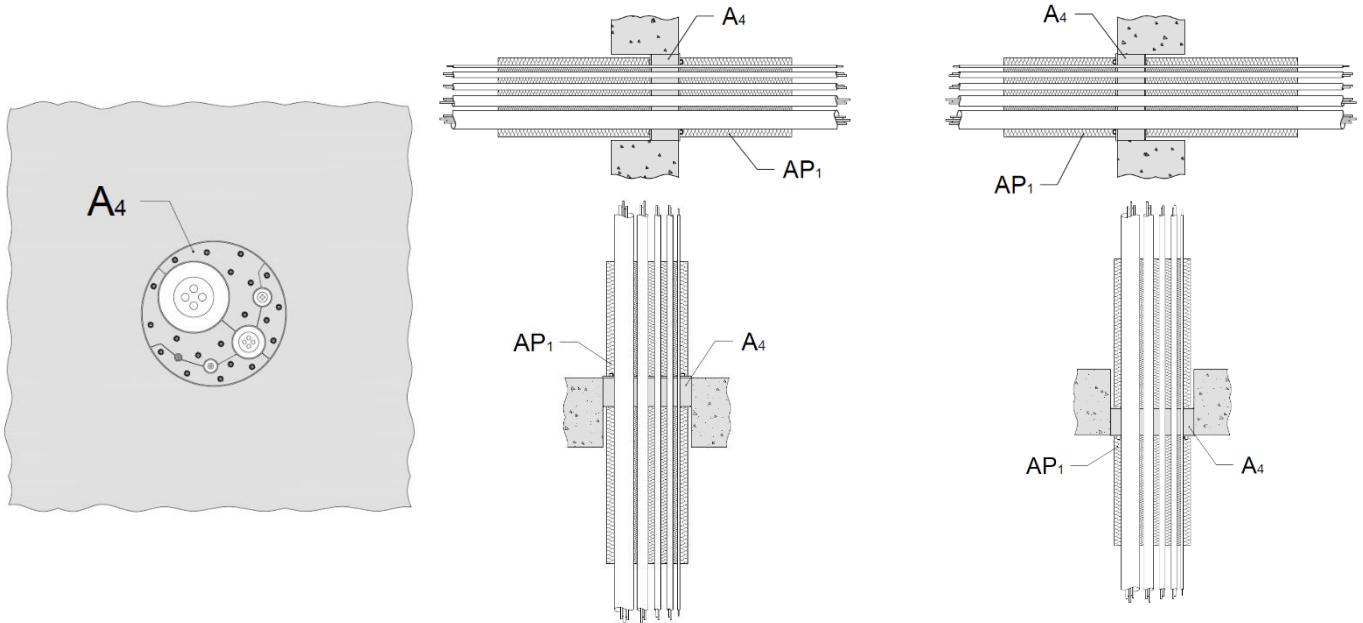
Cable insulation (AP_1) seal size acc B.15.3.1 and C.5.10.1

- Position: insulation on each service, symmetrical on both sides of the wall
- Fixed: mineral wool with steel gauze (min. thickness 0,7 mm); Insulation lengths of the services see Annex C of the ETA.

B.10 Product: RR Vario series

B.10.1 System description

The made-to-order system Type “Hilti Firestop Cable Transit CFS-T RR Vario” consists of an elastic plug seal, stone wool cable insulation and lubricant.



Plug seal (A₄):

- Material: flexible, non-flammable, halogen free elastomeric rubber (HFE)
- Max. dimensions: Ø 300 x 60 mm (type CFS-T RR Vario 300)
- Types: Hilti CFS-T RR Vario 60, CFS-T RR Vario 70, CFS-T RR Vario 80, CFS-T RR Vario 100, CFS-T RR Vario 125, CFS-T RR Vario 150, CFS-T RR Vario 200, CFS-T RR Vario 250, CFS-T RR Vario 300
- Position: inside the opening(s) of the wall/floor
- Fixed: clamped inside the wall/floor opening by tightening the bolts of the clamp plates

Seal insulation:

Cable insulation (AP₁):

- Material: stone wool according to Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 20 mm
- Position: insulation on the cables on both sides of the wall / floor
- Fixed: with tie wire at least every 200 mm. Insulation lengths of the cables, see Annex C of the ETA

B.10.2 Seal size

Range: min. Ø 61 mm (CFS-T RR Vario 60) up to max. Ø 302 mm (CFS-T RR Vario 300)

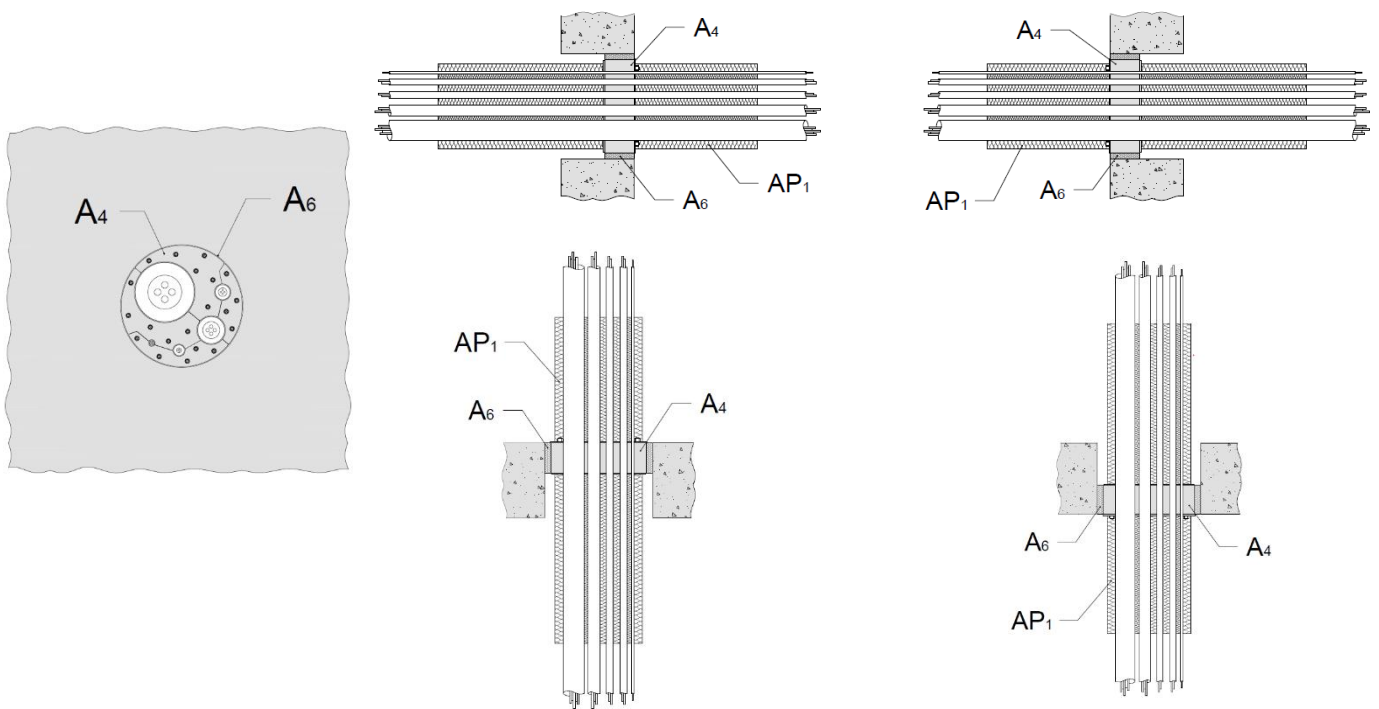
B.10.3 Number of penetrations

Min.1 cable and max.5 cable penetrations starting from Hilti CFS-T RR Vario 60 up to Hilti CFS-T RR Vario 300, details given in Annex C of the ETA

B.11 Product: RR Vario series + SST series

B.11.1 System description

The made-to-order system Type “Hilti Firestop Cable Transit CFS-T RR Vario” consists of a sealing strip applied on the perimeter of the plug, an elastic plug seal, stone wool cable insulation and lubricant.



Plug seal (A₄):

- Material: flexible, non-flammable, halogen free elastomeric rubber (HFE)
- Max. dimensions: Ø 300 x 60 mm (type CFS-T RR Vario 300)
- Types: Hilti CFS-T RR Vario 60, CFS-T RR Vario 70, CFS-T RR Vario 80, CFS-T RR Vario 100, CFS-T RR Vario 125, CFS-T RR Vario 150, CFS-T RR Vario 200, CFS-T RR Vario 250, CFS-T RR Vario 300
- Position: inside the opening(s) of the wall/floor
- Fixed: clamped inside the wall/floor opening by tightening the bolts of the clamp plates

Sealing strip (A₆):

- Material: flexible, non-flammable, halogen free elastomeric rubber (HFE)
- Max. dimensions: 60x4x720 mm
- Types: CFS-T SST 60x1x720, CFS-T SST 60x4x720
- Position: around the perimeter of the plug seal
- Fixed: overlapping layers after one or several full round(s)

Seal insulation:

Cable insulation (AP₁):

- Material: stone wool according to Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 20 mm
- Position: insulation on the cables on both sides of the wall / floor
- Fixed: with tie wire at least every 200 mm. Insulation lengths of the cables, see Annex C of the ETA

B.11.2 Seal size

Range: min. Ø 64 mm (CFS-T RR Vario 60) up to max. Ø 304 mm (CFS-T RR Vario 300)

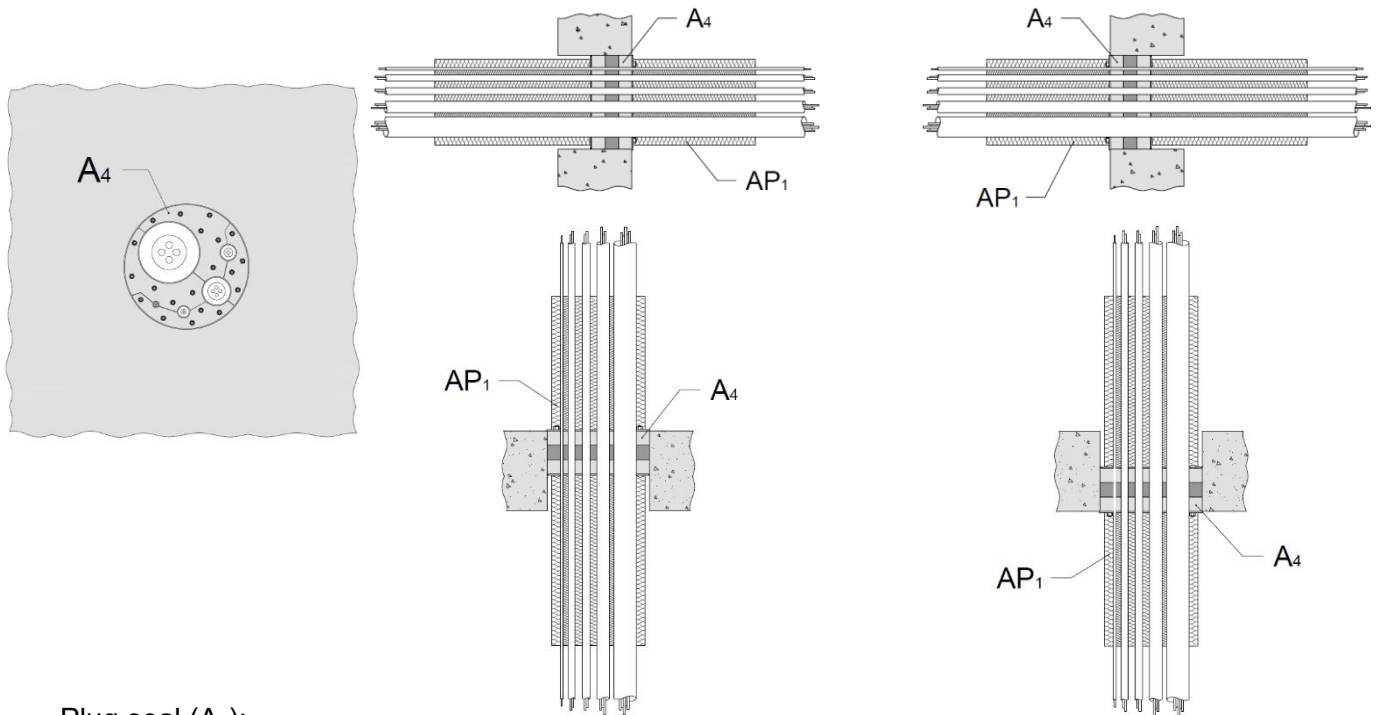
B.11.3 Number of penetrations

Min.1 cable and max.5 cable penetrations starting from Hilti CFS-T RR Vario 60 up to Hilti CFS-T RR Vario 300, details given in Annex C of the ETA.

B.12 Product: RR Vario (H) series

B.12.1 System description

The made-to-order system Type “Hilti Firestop Cable Transit CFS-T RR Vario (H)” consists of an elastic plug seal, stone wool cable insulation and lubricant.



Plug seal (A₄):

- Material: flexible, non-flammable, halogen free elastomeric rubber (HFE)
- Max. dimensions: Ø 300 x 90 mm (type CFS-T RR Vario (H) 300)
- Types: Hilti CFS-T RR Vario (H) 60, CFS-T RR Vario (H) 70, CFS-T RR Vario (H) 80, CFS-T RR Vario (H) 100, CFS-T RR Vario (H) 125, CFS-T RR Vario (H) 150, CFS-T RR Vario (H) 200, CFS-T RR Vario (H) 250, CFS-T RR Vario (H) 300
- Position: inside the opening(s) of the wall/floor
- Fixed: clamped inside the wall/floor opening by tightening the bolts of the clamp plates

Seal insulation:

Cable insulation (AP₁):

- Material: stone wool according to Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 20 mm
- Position: insulation on the cables on both sides of the wall / floor
- Fixed: with tie wire at least every 200 mm. Insulation lengths of the cables, see Annex C of the ETA

B.12.2 Seal size

Range: min. Ø 61 mm (CFS-T RR Vario (H) 60) up to max. Ø 302 mm (CFS-T RR Vario (H) 300)

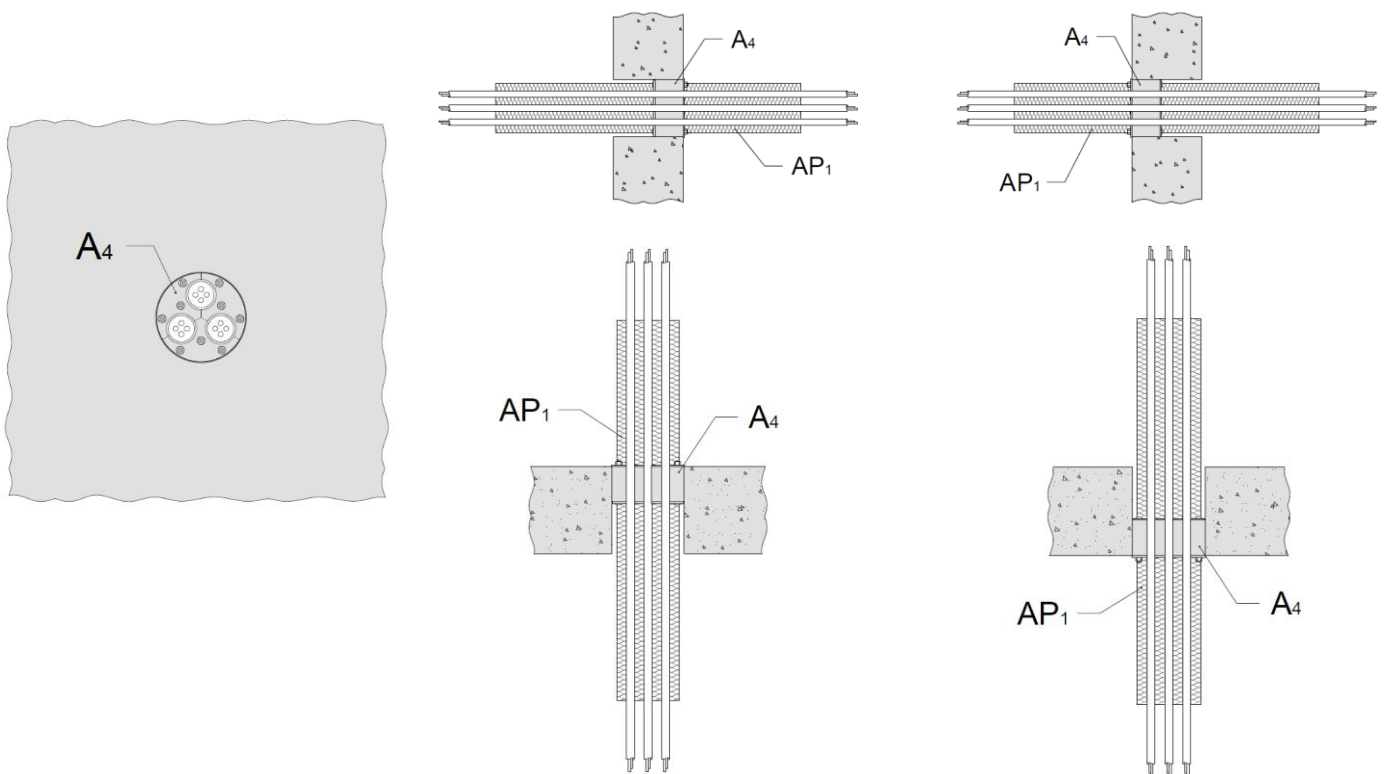
B.12.3 Number of penetrations

Min.1 cable and max.5 cable penetrations starting from Hilti CFS-T RR Vario (H) 60 up to Hilti CFS-T RR Vario (H) 300, details given in Annex C of the ETA.

B.13 Product: RR3 series

B.13.1 System description

The adapter based modular system Type “Hilti Firestop Cable Transit CFS-T RR3” consists of an elastic plug seal, stone wool cable insulation, elastomeric rubber adapters and lubricant.



Plug seal (A₄):

- Material: flexible, non-flammable, halogen free elastomeric rubber (HFE)
- Max. dimensions: Ø 200 x 60 mm (type CFS-T RR3 200)
- Types: Hilti CFS-T RR3 150, CFS-T RR3 200
- Position: inside the opening(s) of the wall/floor
- Fixed: clamped inside the wall/floor opening by tightening the bolts of the clamp plates

Seal insulation:

Cable insulation (AP₁):

- Material: stone wool according to Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 20 mm
- Position: insulation on the cables on both sides of the wall / floor
- Fixed: with tie wire at least every 200 mm. Insulation lengths of the cables, see Annex C of the ETA

B.13.2 Seal size

Range: min. Ø 151 mm (CFS-T RR3 150), max. Ø 202 mm (CFS-T RR3 200)

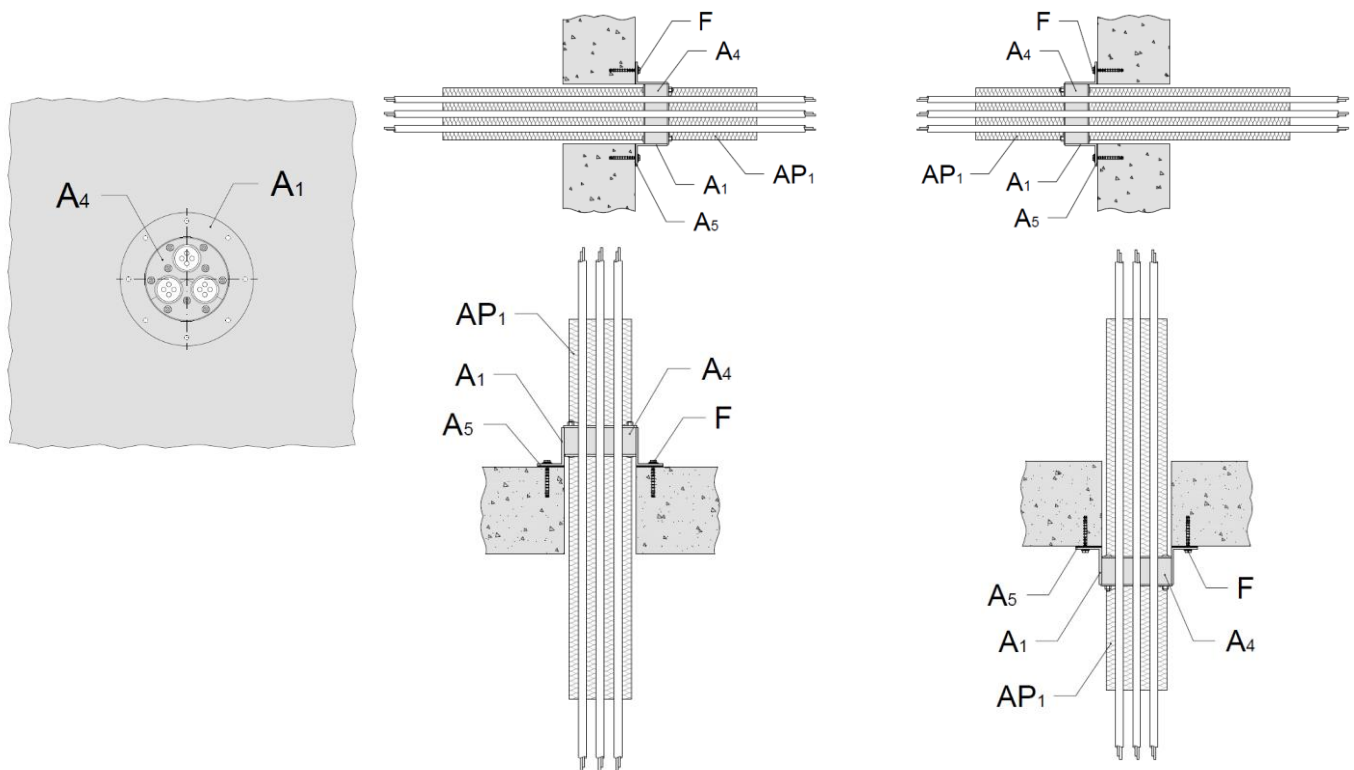
B.13.3 Number of penetrations

Three cable penetrations for each sizes Hilti CFS-T RR3 150 and Hilti CFS-T RR3 200, details given in Annex C of the ETA.

B.14 Product: RR3 series + SLF series

B.14.1 System description

The adapter based modular system Type “Hilti Firestop Cable Transit CFS-T RR3” consists of a flanged steel sleeve, an elastic plug seal, stone wool cable insulation, elastomeric rubber adapters and lubricant.



Steel Sleeve (A₁):

- Material: mild steel primed (MSP)
- Max. dimensions: Ø 200 mm (type CFS-T SLF 200 MSP, outer diameter 320 mm, height 70 mm, thickness 5 mm and 8 mm)
- Types: Hilti CFS-T SLF 150, CFS-T SLF 200 MSP (surface mounted)
- Fixed (F): with Hilti HUS3-H screw anchor and washer to the wall/floor, 6 pieces for SLF 150 and 8 pieces for SLF 200

Smoke tightness between sleeve and support construction according Annex B.16 of the ETA.

Plug seal (A₄):

- Material: flexible, non-flammable, halogen free elastomeric rubber (HFE)
- Max. dimensions: Ø 200 x 60 mm (type CFS-T RR3 200)
- Types: Hilti CFS-T RR3 150, CFS-T RR3 200
- Position: inside the steel sleeve of the wall/floor
- Fixed: clamped inside the steel sleeve opening by tightening the bolts of the clamp plates

Seal insulation:

Cable insulation (AP₁):

- Material: stone wool according to Annex B, table B.15.1 of the ETA with density of 80 kg/m³ and a thickness of 20 mm
- Position: insulation on the cables on both sides of the wall / floor
- Fixed: with tie wire at least every 200 mm. Insulation lengths of the cables, see Annex C of the ETA

B.14.2 Seal size

Range: min. Ø 151 mm (CFS-T RR3 150), max. Ø 202 mm (CFS-T RR3 200)

B.14.3 Number of penetrations

Three cable penetrations for each sizes Hilti CFS-T RR3 150 and Hilti CFS-T RR3 200, details given in Annex C of the ETA.

B.15 Insulation material

B.15.1 Mineral wool products for additional cable, plug and metal frame protection

Table B.15.1: Specification for mineral wool products suitable for being used as additional protection for cables, plugs and metal frames (relevant for Annex B.1 to B.3.1, B.4 to B.6, B.7.1, B.8.1, B.9.1, B.10 to B.14 of ETA)

Characteristic	Specification	Unit
Stone wool according to EN 14303		
Reaction to fire class according to EN 13501-1	A1	-
Thermal conductivity at 20°C	≤ 0.040	W/(mK)
Density	≥ 80	kg/m ³

The following list contains suitable products but may not be exhaustive:

Manufacturer	Product designation
Isover	MD 100
Isover	MD 2
Isover	ULTIMATE TECH WIRED MAT 5.0 N
Isover	Protect
Rockwool	ProRox WM 80
Rockwool	RTD Plus
Rockwool	Klimarock

B.15.2 Mineral wool products for additional pipe protection

Table B.15.2: Specification for mineral wool products suitable for being used as pipe insulation (relevant for Annex B.1, B.2, B.3.1, B.4 to B.6 of the ETA)

Interrupted insulation	
Stone wool according to EN 14303, class A2 or A1 according to EN 13501-2, Al-faced	
Additional insulation	
Manufacturer	Product designation
Isover	Coquilla AT-LR
Isover	Protect BSR 90 alu
Paroc	Section AluCoat T
Rockwool	Conlit Pipe sections
Rockwool	Klimarock
Rockwool	RS 800 pipe sections

B.15.3 Mineral wool products for additional service insulation

Table B.15.3.1: Specification for mineral wool products suitable for being used as service insulation (relevant for Annex B.3.2, B.7.2, B.8.2 (RSS till 100 mm diameter) and B.9.2 of the ETA)

Interrupted insulation	
Stone wool according to EN 14303, class A2 or A1 according to EN 13501-2, Al-faced; minimum density 30 kg/m ³	
Additional insulation	
Manufacturer	Product designation
Paroc	HVAC Combi Alucoat T

Table B.15.3.2: Specification for mineral wool products suitable for being used as service insulation (relevant for Annex B.8.2 - specific for RRS dimensions 101 – 200 mm of the ETA)

Interrupted insulation	
Stone wool according to EN 14303, class A2 or A1 according to EN 13501-2, Al-faced; minimum density 90 kg/m ³	
Additional insulation	
Manufacturer	Product designation
Isover	U-Protect pipe section Alu2

B.15.4 Synthetic rubber insulation for penetration protection

Table B.15.4: Specification for synthetic rubber insulation (relevant for Annex C.3 and C.5 of the ETA)

Additional insulation – local interrupted		
Manufacturer	Product designation	
Armacell	ArmaFlex EVO AF	
Characteristic	Specification	Unit
Reaction to fire class according to EN 13501-1	B _L -s2, d0	-
Density	52,5	kg/m ³

B.16 Smoke tightness

Ancillary products “Hilti Firestop Acrylic Sealant CFS-S ACR” (A₅) for smoke tightness:

A detailed specification of the product “Hilti Firestop Acrylic Sealant CFS-S ACR” is contained in document “Identification / Product Specification relating to the European Technical Assessment ETA-10/0292 and ETA-10/0389 - Hilti Firestop Acrylic Sealant CFS-S ACR” which is a non-public part of the referenced ETAs.

The Control Plan is defined in document “Control Plan relating to the European Technical Assessment ETA-10/0292 and ETA-10/0389 - Hilti Firestop Acrylic Sealant CFS-S ACR” which is a non-public part of the referenced ETAs.

ANNEX C - RESISTANCE TO FIRE CLASSIFICATION OF PENETRATION SEALS MADE OF "HILTI FIRESTOP CABLE TRANSIT CFS-T"

C.1 General Information

The penetration seals may only be penetrated by the services described in Annex C.2 till C.8 of the ETA. Other parts or support constructions must not penetrate the penetration seal.

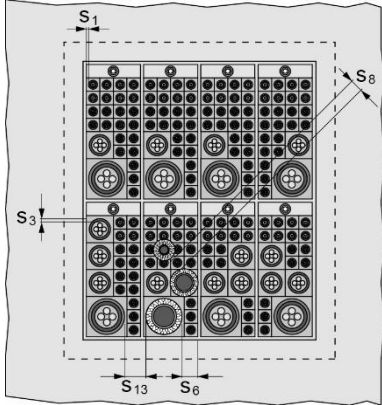
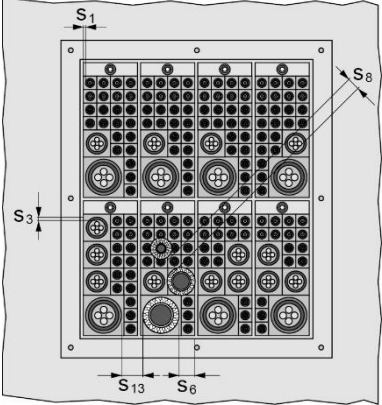
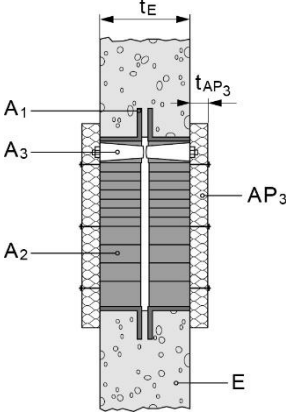
The service support construction must be fixed to the building element containing the penetration seal or a suitable adjacent building element, on both sides of the penetration in such a manner that in the case of fire, no additional load is imposed on the seal. Furthermore, it is assumed that this support is maintained on the unexposed side, for the required period of fire resistance.

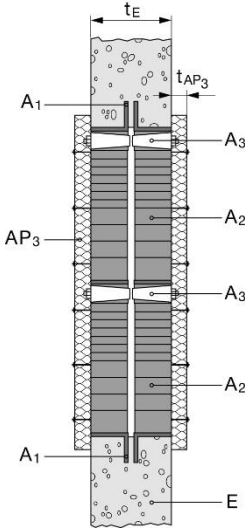
The classifications relate to C/U (capped inside the furnace/uncapped outside) for metal pipes. For further information refer to national regulations.

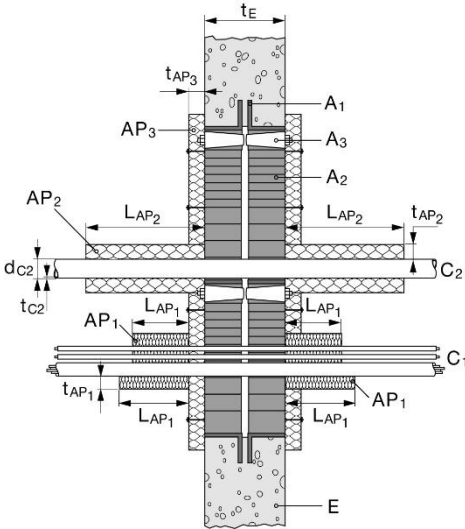
C.1.1 Wall/floor constructions

- a) Rigid walls: The wall must have a minimum thickness of 150 / 200 mm and comprise concrete, with a minimum density of 450 / 550 / 2200 kg/m³ (see clause 2.1 of the ETA).
- b) Rigid floors: The floor must have a minimum thickness of 150 / 200 mm and comprise concrete with a minimum density of 650 / 2200 kg/m³ (see clause 2.1 of the ETA).

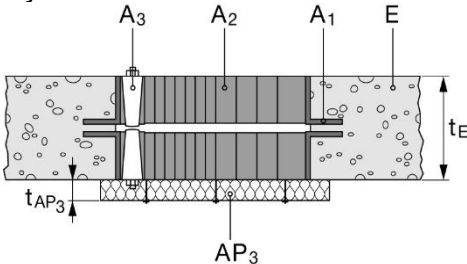
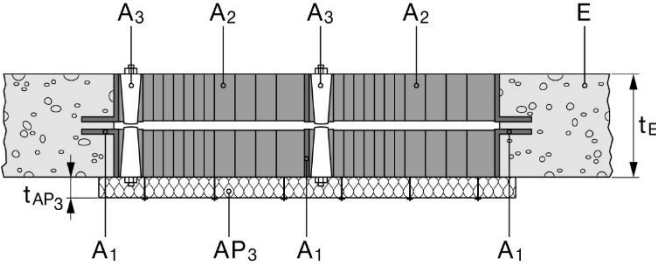
The walls / floors must be classified in accordance with EN 13501-2 for the required fire resistance period or fulfil the requirements of the relevant Eurocode. This ETA does not cover use of the product as a penetration seal in sandwich panel constructions.

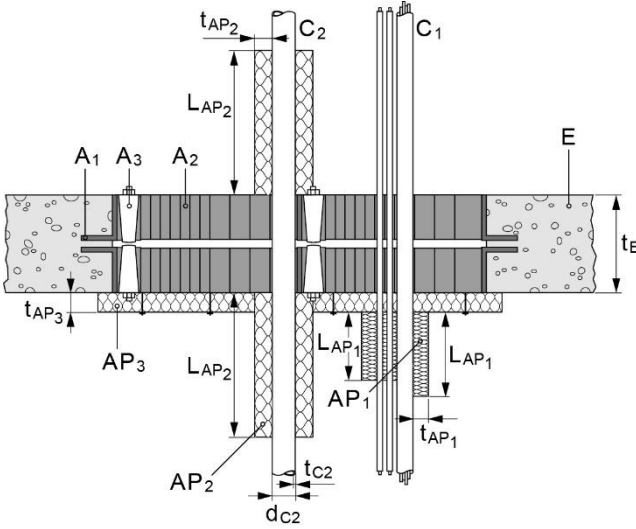
C.2 Penetration seal system Hilti CFS-T SB and CFS-T SBO in rigid walls and floors	
according to Annex C.1.1 of the ETA	
Maximum distance for first service support: 420 mm. Maximum seal size: 504 x 562 mm (width x height). Minimum distances in mm cable and metal pipe penetration seal: $s_1 = 5$ (distance between cables and the side seal edge) $s_3 = 5$ (distance between cables and upper seal edge) $s_6 = 0$ (distance between the insulation of metal pipes and the seal edge) $s_8 = 0$ (distance between the insulation of metal pipes) $s_{13} = 90$ (distance between cables and metal pipes) The results are also valid for mixed penetration seals Minimum distances in mm (see illustration of distances below): SB  SBO 	
C.2.1 Rigid Walls according to Annex C.1.1 of the ETA – minimum wall thickness 150 mm	
C.2.1.1 Blank seal (no services) - System: CFS-T SB	Classification
- Single frame Maximum seal size: 277 mm x 120 mm (CFS-T SB 8x1), Construction details (for symbols and abbreviations see Annex A of the ETA): 	EI 180

- Multiple frame Maximum seal size: 504 mm x 562 mm (CFS-T SB 8+8x4), Construction details (for symbols and abbreviations see Annex A of the ETA): 	EI 180
--	--------

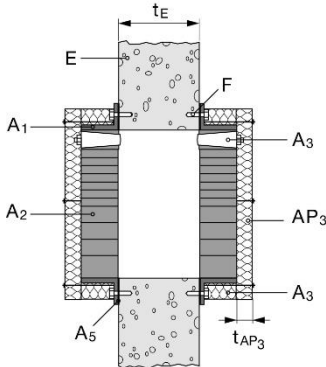
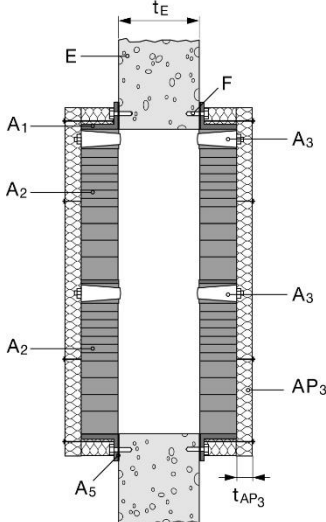
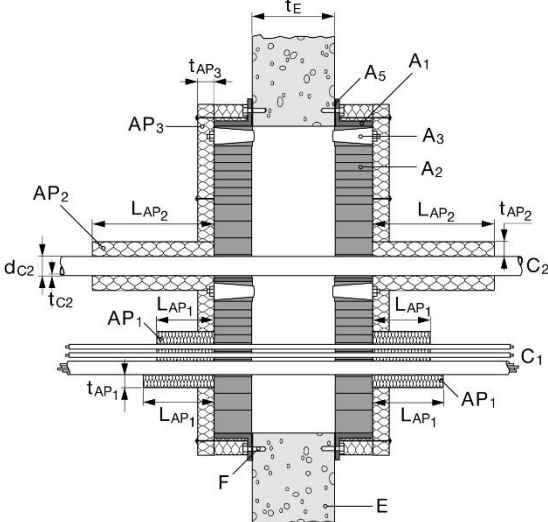
C.2.1.2 Cable penetration - System: CFS-T SB			
Maximum seal size: 504mm x 562mm (CFS-T SB 8+8x4) Construction details (for symbols and abbreviations see Annex A):			
			
Cable diameter C_1 (mm)	Cable insulation thickness t_{AP1} (mm)	Cable insulation length L_{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables) with a diameter of:			
Small cable group max. Ø21mm	30	250	EI 180
Medium cable group max. Ø50mm	30	250	EI 180
Large cable group max. Ø80mm	30	250	EI 120 / E 180

C.2.1.3 Non-combustible pipe penetration - System: CFS-T SB					
Maximum seal size: 504mm x 562mm (CFS-T SB 8+8x4)					
Pipe diameter d_{C2} (mm)	Pipe wall thickness t_{C2} (mm)	Thickness of pipe insulation t_{AP2} (mm)	Length of pipe insulation L_{AP2} (mm)	Arrangement pipe insulation	Classification
15	1 – 14,2	≥ 30	≥ 500	LI	EI 180
15 – 28	1 – 14,2	≥ 30	≥ 500	LI	EI 120-C/U, E 180-C/U
28 – 54	1/1,5 – 14,2	≥ 30	≥ 500	LI	
15 – 28	1 – 14,2	≥ 30	-	CI	EI 180
28 – 54	1/1,5 – 14,2	≥ 30	-	CI	EI 180

C.2.2 Rigid Floors according to Annex C.1.1 of the ETA – minimum floor thickness 200 mm	
C.2.2.1 Blank seal (no services) - System: CFS-T SB	Classification
- Single frame Maximum seal size: 277mm x 120mm (CFS-T SB 8x1), Construction details (for symbols and abbreviations see Annex A of the ETA): 	EI 180
- Multiple frame Maximum seal size: 504mm x 562mm (CFS-T SB 8+8x4), Construction details (for symbols and abbreviations see Annex A of the ETA): 	EI 180

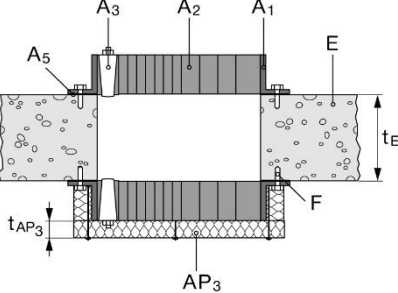
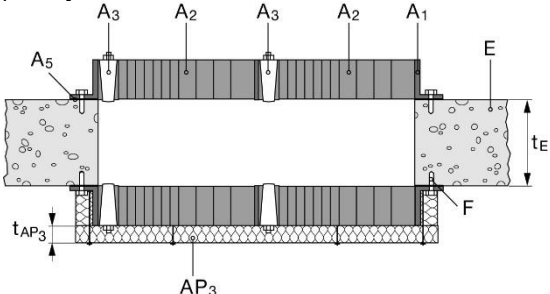
C.2.2.2 Cable penetration - System: CFS-T SB			
Maximum seal size: 504mm x 562mm (CFS-T SB 8+8x4)			
Construction details (for symbols and abbreviations see Annex A of the ETA):			
			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	30	300	EI 180
Medium cable group max. Ø 50 mm	30	300	EI 180
Large cable group max. Ø 80 mm	30	300	EI 120 / E 180

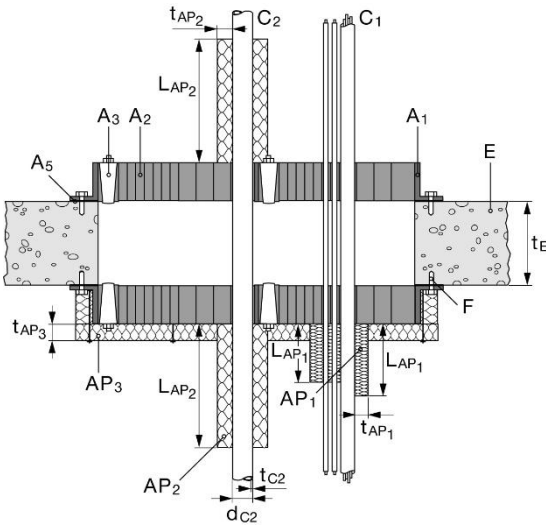
C.2.2.3 Non-combustible pipe penetration - System: CFS-T SB					
Maximum seal size: 504 mm x 562 mm (CFS-T SB 8+8x4)					
Pipe diameter d _{C2} (mm)	Pipe wall thickness t _{C2} (mm)	Thickness of pipe insulation t _{AP2} (mm)	Length of pipe insulation L _{AP2} (mm)	Arrangement pipe insulation	Classification
15 - 28	1 – 14,2	≥ 30	≥ 400	LI	EI 120-C/U, E 180-C/U
28 – 54	1/1,5 – 14,2	≥ 30	≥ 500	LI	
15 – 28	1 – 14,2	≥ 30	-	CI	EI 180
28 – 54	1/1,5 – 14,2	≥ 30	-	CI	EI 180

C.2.3 Rigid Walls according to Annex C.1.1 of the ETA – minimum wall thickness 150 mm	
C.2.3.1 Blank seal (no services) - System: CFS-T SBO	Classification
- Single frame Maximum seal size: 120 mm x 277 mm (CFS-T SBO 8x1), Construction details (for symbols and abbreviations see Annex A of the ETA): 	EI 180
- Multiple frame Maximum seal size: 504 mm x 562 mm (CFS-T SBO 8+8x4), Construction details (for symbols and abbreviations see Annex A of the ETA): 	EI 180
C.2.3.2 Cable penetration - System: CFS-T SBO	
Maximum seal size: 504 mm x 562 mm (CFS-T SBO 8+8x4) Construction details (for symbols and abbreviations see Annex A of the ETA): 	

Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	30	150	EI 180
Medium cable group max. Ø 50 mm	30	150	EI 180
Large cable group max. Ø 80 mm	30	150	EI 120 / E 180

C.2.3.3 Non-combustible pipe penetration - System: CFS-T SBO					
Maximum seal size: 504mm x 562mm (CFS-T SB 8+8x4)					
Pipe diameter d _{C2} (mm)	Pipe wall thickness t _{C2} (mm)	Thickness of pipe insulation t _{AP2} (mm)	Length of pipe insulation L _{AP2} (mm)	Arrangement pipe insulation	Classification
15	1 – 14,2	≥ 30	≥ 250	LI	EI 180
15 – 28	1 – 14,2	≥ 30	≥ 250	LI	EI 120-C/U, E 180-C/U
28 –54	1/1,5 – 14,2	≥ 30	≥ 500	LI	
15 –28	1 – 14,2	≥ 30	-	CI	EI 180
28 –54	1/1,5 – 14,2	≥ 30	-	CI	EI 180

C.2.4 Rigid Floors according to Annex C.1.1 of the ETA – minimum floor thickness 200 mm	
C.2.4.1 Blank seal (no services) - System: CFS-T SBO	Classification
- Single frame Maximum seal size: 277 mm x 120 mm (CFS-T SBO 8x1), Construction details (for symbols and abbreviations see Annex A of the ETA): 	EI 180
- Multiple frame Maximum seal size: 520 mm x 580 mm (CFS-T SBO 8+8x4), Construction details (for symbols and abbreviations see Annex A of the ETA): 	EI 180

C.2.4.2 Cable penetration - System: CFS-T SBO			
Maximum seal size: 504mm x 562mm (CFS-T SBO 8+8x4)			
Construction details (for symbols and abbreviations see Annex A of the ETA):			
			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	30	250	EI 180
Medium cable group max. Ø 50 mm	30	250	EI 180
Large cable group max. Ø 80 mm	30	250	EI 180

C.2.4.3 Non-combustible pipe penetration - System: CFS-T SBO					
Maximum seal size: 520 mm x 580 mm (CFS-T SB 8+8x4)					
Pipe diameter d _{C2} (mm)	Pipe wall thickness t _{C2} (mm)	Thickness of pipe insulation t _{AP2} (mm)	Length of pipe insulation L _{AP2} (mm)	Arrangement pipe insulation	Classification
15 – 28	1 – 14,2	≥ 30	≥ 300	LI	EI 120-C/U, E 180-C/U
28 – 54	1/1,5 – 14,2	≥ 30	≥ 500	LI	
15 – 28	1 – 14,2	≥ 30	-	CI	EI 180
28 – 54	1/1,5 – 14,2	≥ 30	-	CI	EI 180

C.3 Penetration seal system Hilti CFS-T SBF in rigid walls and floors

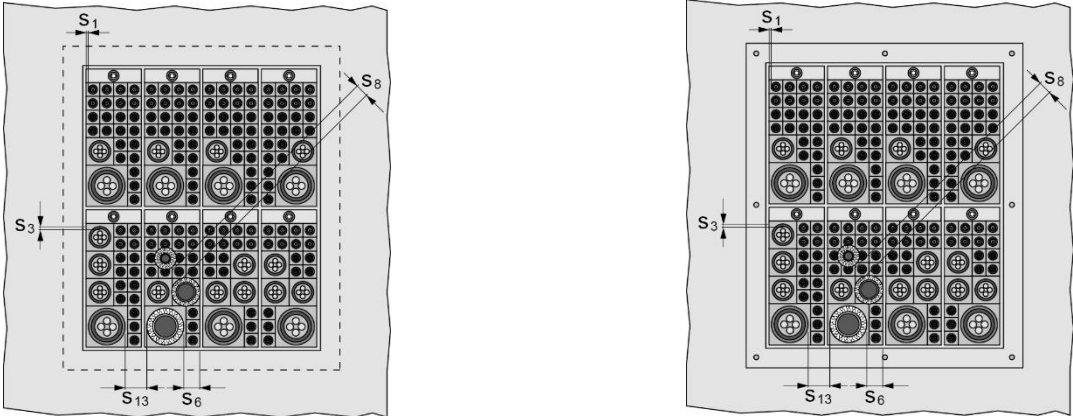
C.3.1 Penetration seal system Hilti CFS-T SBF (back to back) in rigid walls and floors

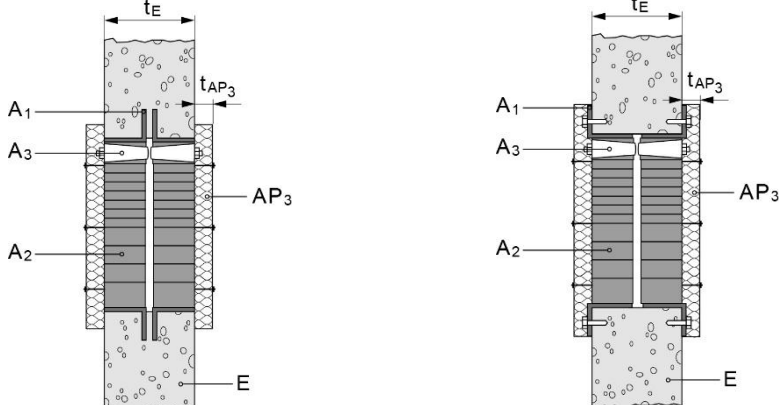
according to Annex C.1.1 of the ETA

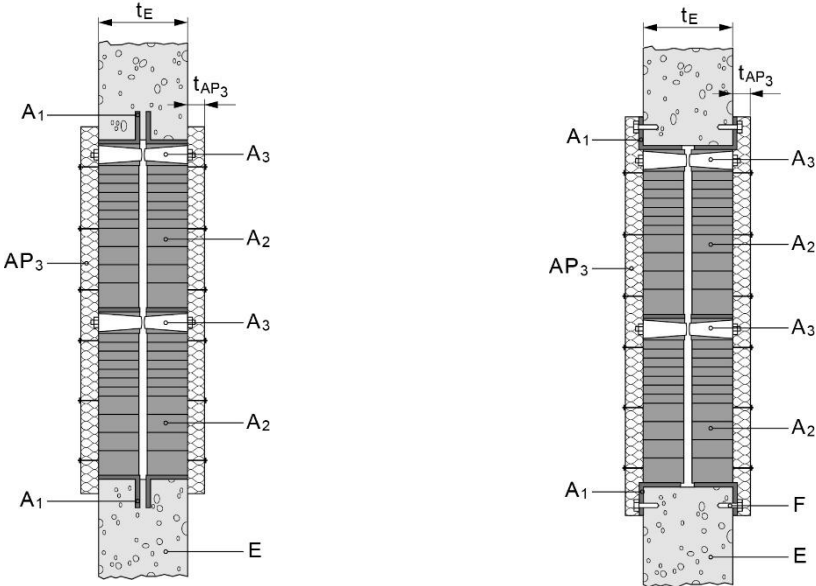
Maximum distance for first service support: 420 mm.
Maximum seal size: 504 x 562 mm (width x height).
Minimum distances in mm cable and metal pipe penetration seal:
 $s_1 = 5$ (distance between cables and the side seal edge)
 $s_3 = 5$ (distance between cables and upper seal edge)
 $s_6 = 0$ (distance between the insulation of metal pipes and the seal edge)
 $s_8 = 0$ (distance between the insulation of metal pipes)
 $s_{13} = 90$ (distance between cables and metal pipes)

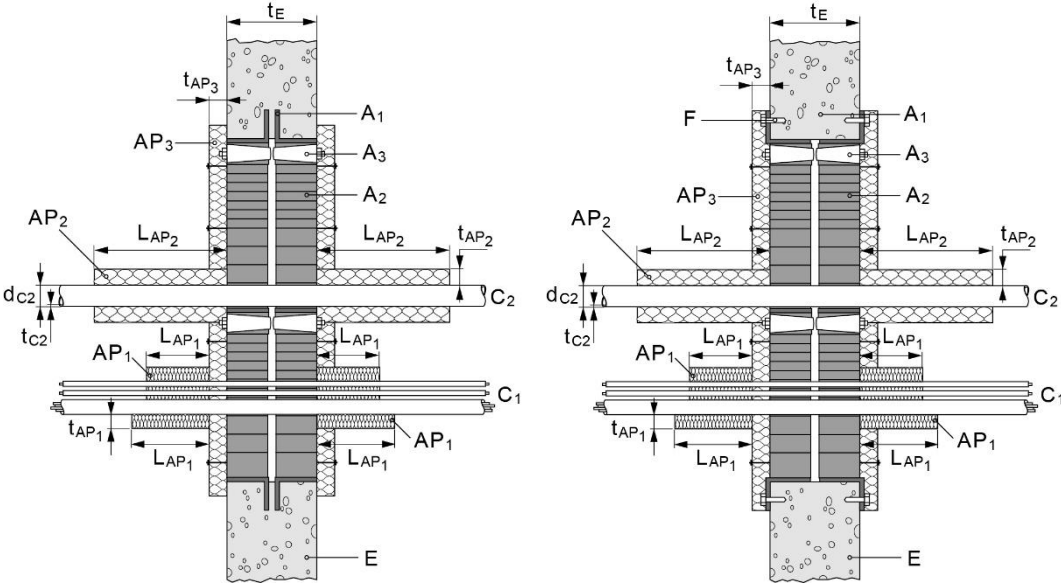
The results are also valid for mixed penetration seals

Minimum distances in mm (see illustration of distances below):

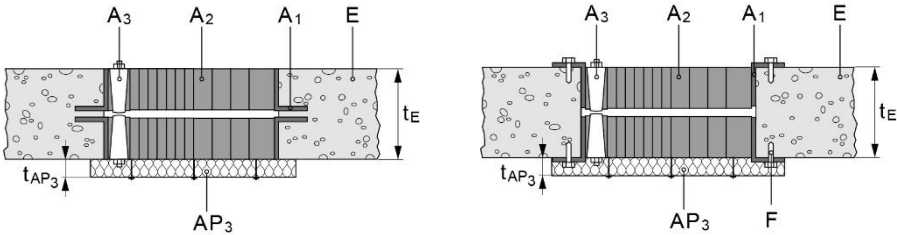
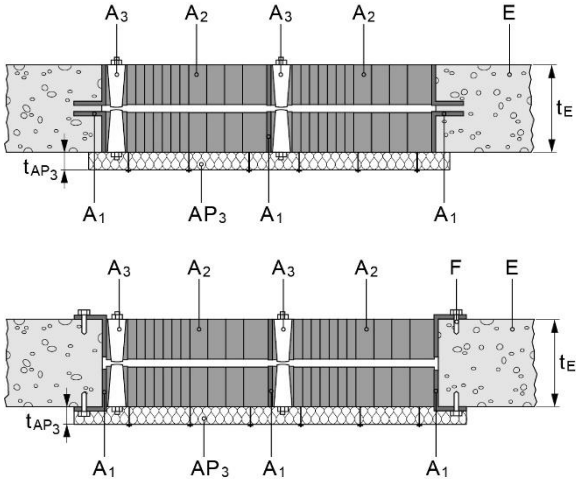


C.3.1.1 Rigid Walls according to Annex C.1.1 of the ETA – minimum wall thickness 150 mm	
C.3.1.1.1 Blank seal (no services) - System: CFS-T SBF	Classification
- Single frame Maximum seal size: 277 mm x 120 mm (CFS-T SBF 8x1), Construction details (for symbols and abbreviations see Annex A of the ETA): 	EI 180

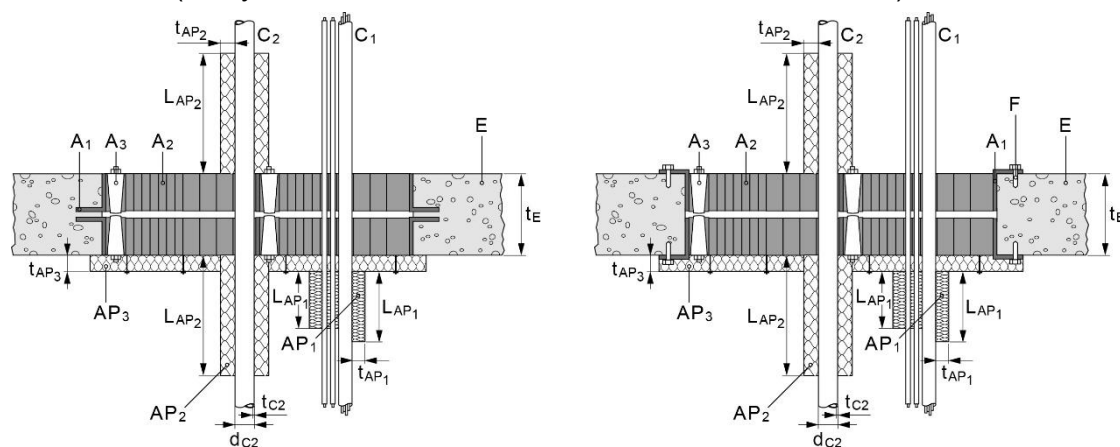
- Multiple frame Maximum seal size: 504 mm x 562 mm (CFS-T SBF 8+8x4), Construction details (for symbols and abbreviations see Annex A of the ETA): 		EI 180
--	--	--------

C.3.1.1.2 Cable penetration - System: CFS-T SBF Maximum seal size: 504mm x 562mm (CFS-T SBF 8+8x4) Construction details (for symbols and abbreviations see Annex A): 			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables) with a diameter of:			
Small cable group max. Ø21mm	30	250	EI 180
Medium cable group max. Ø50mm	30	250	EI 180
Large cable group max. Ø80mm	30	250	EI 120 / E 180

C.3.1.1.3 Non-combustible pipe penetration - System: CFS-T SBF					
Maximum seal size: 504mm x 562mm (CFS-T SBF 8+8x4)					
Pipe diameter d_{C2} (mm)	Pipe wall thickness t_{C2} (mm)	Thickness of pipe insulation t_{AP2} (mm)	Length of pipe insulation L_{AP2} (mm)	Arrangement pipe insulation	Classification
15	1 – 14,2	≥ 30	≥ 500	LI	EI 180
15 – 28	1 – 14,2	≥ 30	≥ 500	LI	EI 120-C/U, E 180-C/U
28 – 54	1/1,5 – 14,2	≥ 30	≥ 500	LI	
15 – 28	1 – 14,2	≥ 30	-	CI	EI 180
28 – 54	1/1,5 – 14,2	≥ 30	-	CI	EI 180

C.3.1.2 Rigid Floors according to Annex C.1.1 of the ETA – minimum floor thickness 200 mm	
C.3.1.2.1 Blank seal (no services) - System: CFS-T SBF	Classification
- Single frame Maximum seal size: 277mm x 120mm (CFS-T SBF 8x1), Construction details (for symbols and abbreviations see Annex A of the ETA): 	EI 180
- Multiple frame Maximum seal size: 504mm x 562mm (CFS-T SBF 8+8x4), Construction details (for symbols and abbreviations see Annex A of the ETA): 	EI 180

Construction details (for symbols and abbreviations see Annex A of the ETA):



Cable diameter C_1 (mm)	Cable insulation thickness t_{AP1} (mm)	Cable insulation length L_{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. $\varnothing$ 21 mm	30	300	EI 180
Medium cable group max. $\varnothing$ 50 mm	30	300	EI 180
Large cable group max. $\varnothing$ 80 mm	30	300	EI 120 / E 180

Maximum seal size: 504 mm x 562 mm (CFS-T SBF 8+8x4)

Pipe diameter d_{C2} (mm)	Pipe wall thickness t_{C2} (mm)	Thickness of pipe insulation t_{AP2} (mm)	Length of pipe insulation L_{AP2} (mm)	Arrangement pipe insulation	Classification
15 - 28	1 – 14,2	≥ 30	≥ 400	LI	EI 120-C/U, E 180-C/U
28 – 54	1/1,5 – 14,2	≥ 30	≥ 500	LI	
15 – 28	1 – 14,2	≥ 30	-	CI	EI 180
28 – 54	1/1,5 – 14,2	≥ 30	-	CI	EI 180

C.3.2 Penetration seal system Hilti CFS-T SBF single sided with CFS-BL in rigid walls

according to Annex C.1.1 of the ETA ≥ 2200 kg/m³

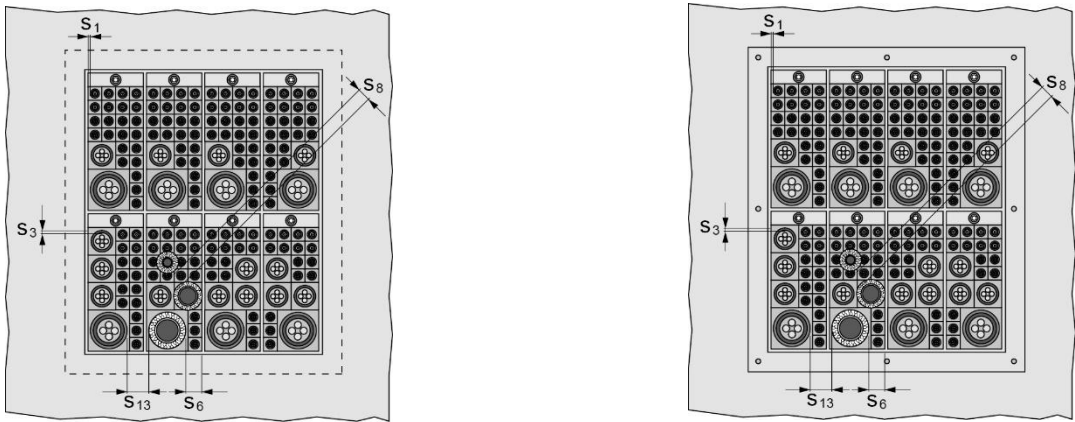
Maximum distance for first service support: 250 mm.

Maximum seal size: 1300 x 870 mm.

Minimum distances in mm cable and metal pipe penetration seal:

- s₁ = 5 (distance between cables and the side seal edge)
- s₃ = 5 (distance between cables and upper seal edge)
- s₆ = 0 (distance between the insulation of metal pipes and the seal edge)
- s₈ = 0 (distance between the insulation of metal pipes)
- s₁₃ = 90 (distance between cables and metal pipes)

Minimum distances in mm (see illustration of distances below):



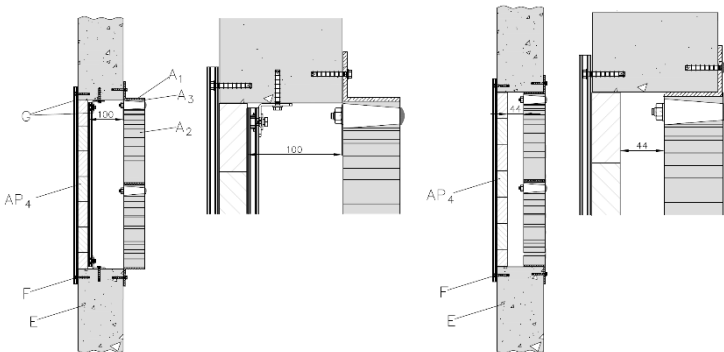
C.3.2.1 Rigid Walls according to Annex C.1.1 of the ETA – minimum wall thickness 150 mm

C.3.2.1.1 Blank seal (no services) - System: CFS-T SBF with CFS-BL

Classification

- Single frame and multiple frame

Maximum frame seal size: ≤ 1403 mm x ≤ 978 mm (CFS-T SBF 8+8+8x10),
Construction details (for symbols and abbreviations see Annex A of the ETA):

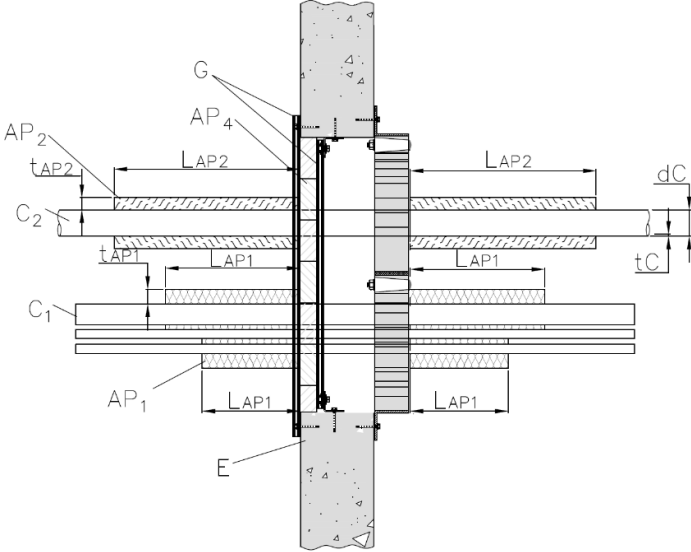


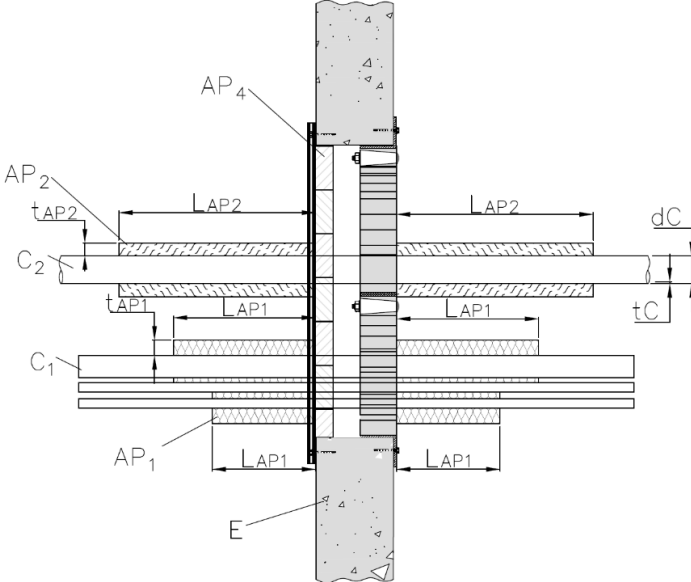
EI 120

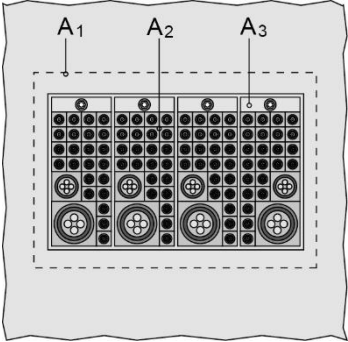
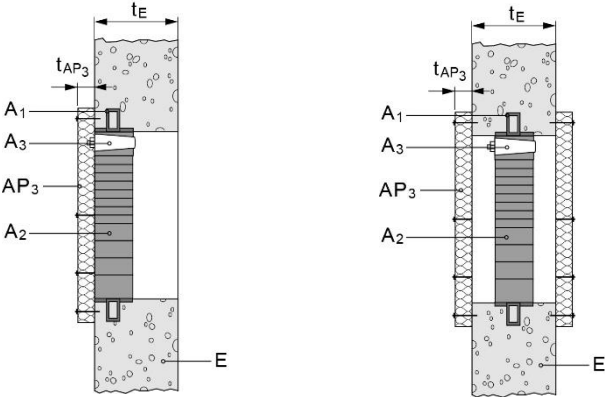
C.3.2.1.2 Cable penetration - System: CFS-T SBF with CFS-BL face fixed and integrated with mineral wool as cable protection			
Construction details (for symbols and abbreviations see Annex A):			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables) with a diameter up to:			
≤ Ø 80mm	≥ 30	≥ 300	EI 120
≤ Ø 80mm	≥ 20	≥ 200	EI 90 / E120

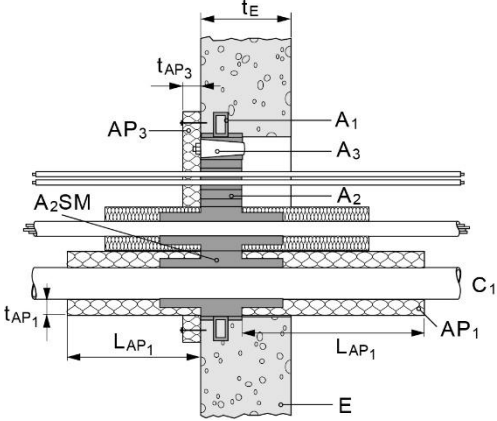
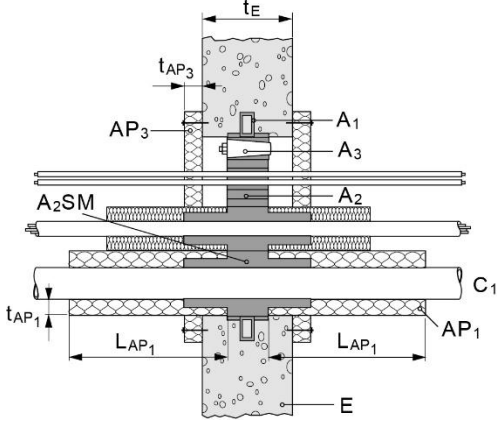
C.3.2.1.3 copper pipe penetration - CFS-T SBF with CFS-BL face fixed and integrated with mineral wool insulation					
Pipe diameter d _{C2} (mm)	Pipe wall thickness t _{C2} (mm)	Thickness of pipe insulation t _{AP2} (mm)	Length of pipe insulation L _{AP2} (mm)	Arrangement pipe insulation	Classification
≤ 10	≥ 0,6	≥ 30	≥ 400	LI	EI 120 C/U
≤ 54	≥ 1,2	≥ 30	≥ 400	LI	EI 120 C/U

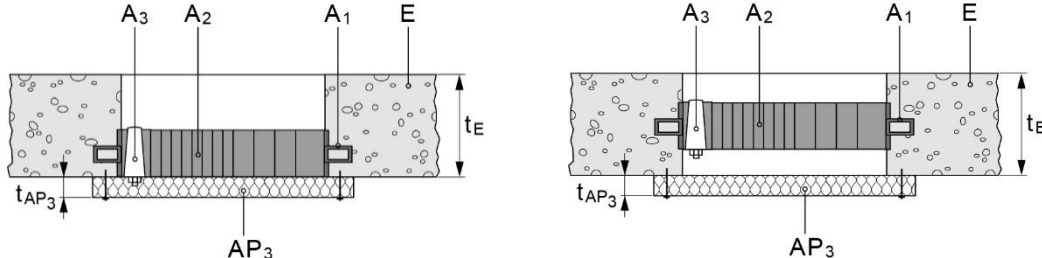
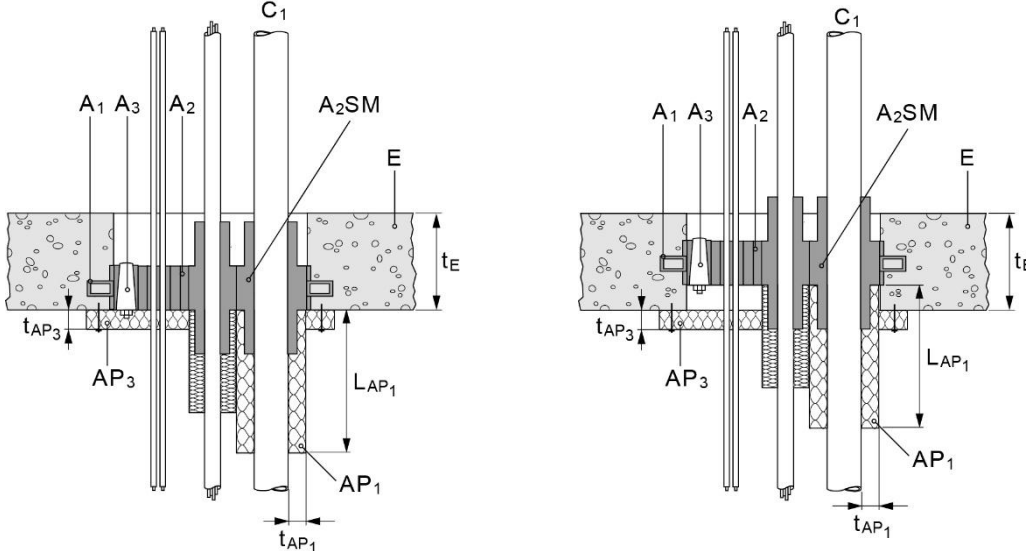
C.3.2.1.4 copper pipe penetration - CFS-T SBF with CFS-BL face fixed and integrated with synthetic rubber insulation					
Pipe diameter d _{C2} (mm)	Pipe wall thickness t _{C2} (mm)	Thickness of pipe insulation t _{AP2} (mm)	Length of pipe insulation L _{AP2} (mm)	Arrangement pipe insulation	Classification
≤ 10	≥ 0,6	32 – 38	≥ 400	LI	EI 90 C/U E 120 C/U
≤ 54	≥ 1,2	32 – 38	≥ 400	LI	EI 90 C/U E 120 C/U

C.3.2.1.5 Cable penetration - System: CFS-T SBF with CFS-BL face fixed and synthetic rubber insulation			
Construction details (for symbols and abbreviations see Annex A):			
			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables) with a diameter up to:			
≤ Ø 80mm	32 – 37.5	≥ 300	EI 120

C.3.2.1.6 Cable penetration - System: CFS-T SBF with CFS-BL integrated and synthetic rubber			
Construction details (for symbols and abbreviations see Annex A):			
			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables) with a diameter up to:			
≤ Ø 80mm	32 – 37.5	≥ 300	EI 90 / E 120

C.4 Penetration seal system Hilti CFS-T SBS and CFS-T SBSO in rigid walls and floors according to Annex C.1.1 of the ETA		
Maximum distance for first service support: 420 mm. Maximum seal size 8x4: 595 x 347 mm (width x height). Maximum seal size 8+8x2: 582 x 262 mm (width x height). Minimum distances in mm cable and metal pipe penetration seal: $s_1 = 5$ (distance between cables and the side seal edge) $s_3 = 5$ (distance between cables and upper seal edge) $s_6 = 0$ (distance between the insulation of metal pipes and the seal edge) $s_8 = 0$ (distance between the insulation of metal pipes) $s_{13} = 90$ (distance between cables and metal pipes) The results are also valid for mixed penetration seals Minimum distances in mm (see illustration of distances below):		
		
C.4.1 Rigid Walls according to Annex C.1.1 of the ETA – minimum wall thickness 200 mm		
C.4.1.1 Blank seal (no services) - System: CFS-T SBS and CFS-T SBSO	Classification	
- Single frame Maximum seal size: 277 mm x 120 mm (CFS-T SBS and CFS-T SBSO 8x1), Construction details (for symbols and abbreviations see Annex A of the ETA):	EI 120	
		

C.4.1.2 Cable penetration - System: CFS-T SBS and CFS-T SBSO				
Maximum seal size: 595 mm x 347 mm (CFS-T SBS and CFS-T SBSO 8x4) Maximum seal size: 582 mm x 262 mm (CFS-T SBS and CFS-T SBSO 8+8x2) Construction details (for symbols and abbreviations see Annex A):				
 				
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Super module (CFS-T SM) A ₂ SM	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables) with a diameter of:				
Small cable group max. Ø 13 mm	without	without	without	EI 120
Small cable group max. Ø 21 mm	30	300	without	EI 120
Medium cable group max. Ø 50 mm	30	300	yes	EI 120
Large cable group max. Ø 80 mm	30	300	yes	EI 120

C.4.2 Rigid Floors according to Annex C.1.1 of the ETA – minimum floor thickness 150 mm				
C.4.2.1 Blank seal (no services) - System: CFS-T SBS and CFS-T SBSO				Classification
Maximum seal size: 595 mm x 347 mm (CFS-T SBS and CFS-T SBSO 8x4), Maximum seal size: 582 mm x 262 mm (CFS-T SBS and CFS-T SBSO 8+8x2) Construction details (for symbols and abbreviations see Annex A of the ETA):				EI 120
				
C.4.2.2 Cable penetration - System: CFS-T SBS and CFS-T SBSO				
Maximum seal size: 595 mm x 347 mm (CFS-T SBS and CFS-T SBSO 8x4) Maximum seal size: 582 mm x 262 mm (CFS-T SBS and CFS-T SBSO 8+8x2) Construction details (for symbols and abbreviations see Annex A of the ETA):				
				
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Super module (CFS-T SM) A ₂ SM	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables) with a diameter of:				
Small cable group max. Ø 13 mm	without	without	Without	EI 120
Small cable group max. Ø 21 mm	30	300	without	EI 120
Medium cable group max. Ø 50 mm	30	300	yes	EI 120
Large cable group max. Ø 80 mm	30	300	yes	EI 120

C.5 Penetration seal system Hilti CFS-T RR and CFS-T RRS in rigid walls and floors

according to Annex C.1.1 of the ETA

Maximum distance for first service support: 420 mm.
 Maximum seal size: Ø 205mm (diameter).
 Minimum distances in mm cable and metal pipe penetration seal:

$s_1 =$
5
 (distance between cables and the side seal edge)

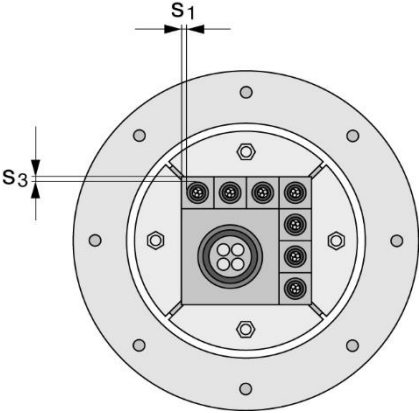
$s_3 =$
5
 (distance between cables and upper seal edge)

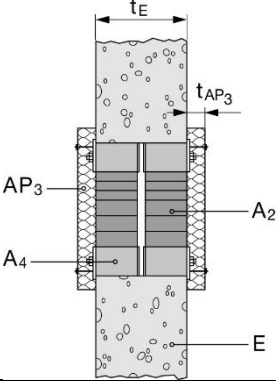
$s_6 =$
0
 (distance between the insulation of metal pipes and the seal edge)

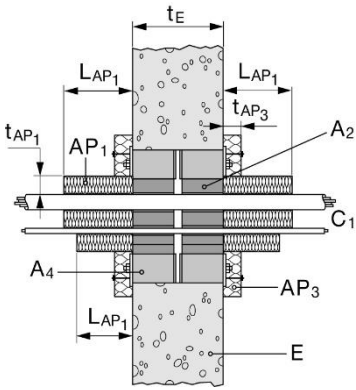
$s_8 =$
0
 (distance between the insulation of metal pipes)

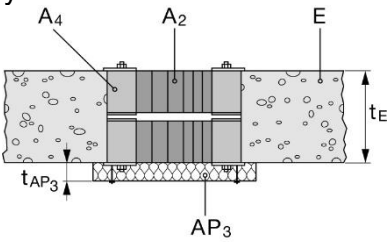
$s_{13} =$
90
 (distance between cables and metal pipes)

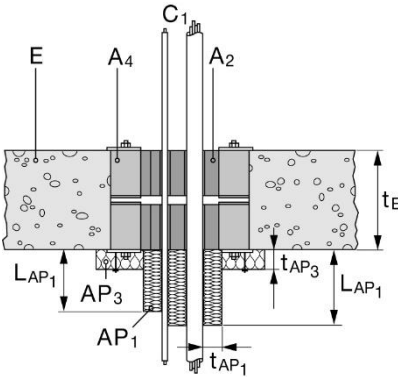
Minimum distances in mm (see illustration of distances below):

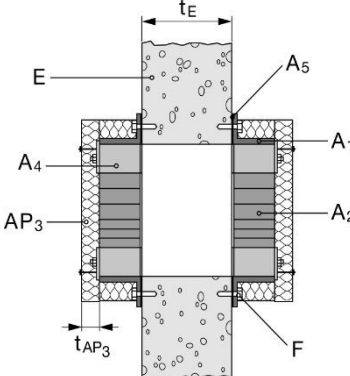


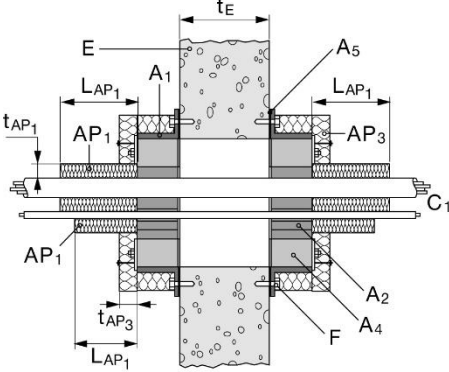
C.5.1 Rigid Walls according to Annex C.1.1 of the ETA – minimum wall thickness 150 mm	
C.5.1.1 Blank seal (no services) - System: CFS-T RR	
Maximum seal size: Ø 205 mm (CFS-T RR-200),	Classification
Construction details (for symbols and abbreviations see Annex A of the ETA):	EI 180
	

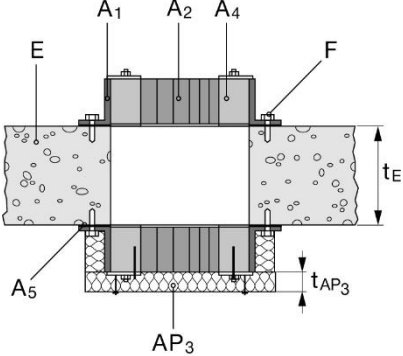
C.5.1.2 Cable penetration - System: CFS-T RR			
Maximum seal size: Ø 205 mm (CFS-T RR-200)			
Construction details (for symbols and abbreviations see Annex A of the ETA): 			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	30	250	EI 180
Medium cable group max. Ø 50 mm	30	250	EI 180
Large cable group max. Ø 80 mm	30	250	EI 120

C.5.2 Rigid Floors according to Annex C.1.1 of the ETA – minimum floor thickness 200 mm	
C.5.2.1 Blank seal (no services) - System: CFS-T RR	
Maximum seal size: Ø 205 mm (CFS-T RR-200),	Classification
Construction details (for symbols and abbreviations see Annex A of the ETA): 	EI 180

C.5.2.2 Cable penetration - System: CFS-T RR			
Maximum seal size: Ø 205 mm (CFS-T RR-200)			
Construction details (for symbols and abbreviations see Annex A of the ETA): 			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	30	300	EI 180
Medium cable group max. Ø 50 mm	30	300	EI 180
Large cable group max. Ø 80 mm	30	300	EI 180

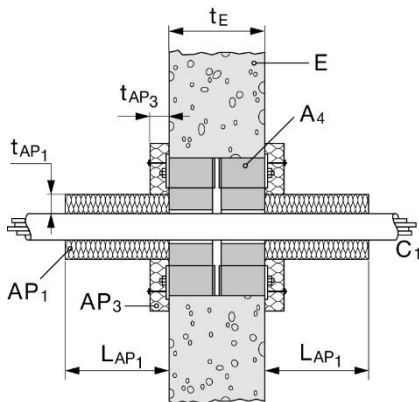
C.5.3 Rigid Walls according to Annex C.1.1 of the ETA – minimum wall thickness 150 mm	
C.5.3.1 Blank seal (no services) - System: CFS-T RR + CFS-T SLF	
Maximum seal size: Ø 205 mm (CFS-T RR-200)	Classification
Construction details (for symbols and abbreviations see Annex A of the ETA): 	EI 180

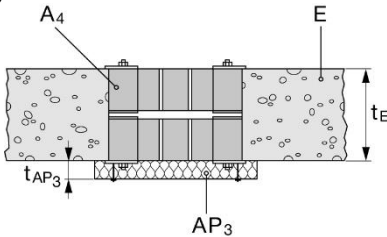
C.5.3.2 Cable penetration - System: CFS-T RR + CFS-T SLF			
Maximum seal size: Ø 205 mm (CFS-T RR-200)			
Construction details (for symbols and abbreviations see Annex A of the ETA):			
			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	30	150	EI 180
Medium cable group max. Ø 50 mm	30	150	EI 180
Large cable group max. Ø 80 mm	30	150	EI 180

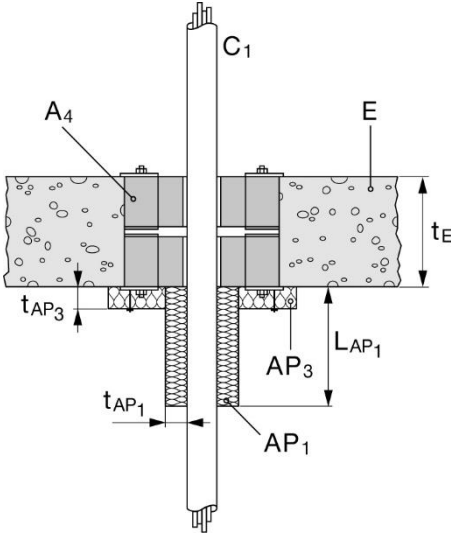
C.5.4 Rigid Floors according to Annex C.1.1 of the ETA – minimum floor thickness 200 mm	
C.5.4.1 Blank seal (no services) - System: CFS-T RR + CFS-T SLF	
Maximum seal size: Ø 205 mm (CFS-T RR-200)	Classification
Construction details (for symbols and abbreviations see Annex A of the ETA):	EI 180
	

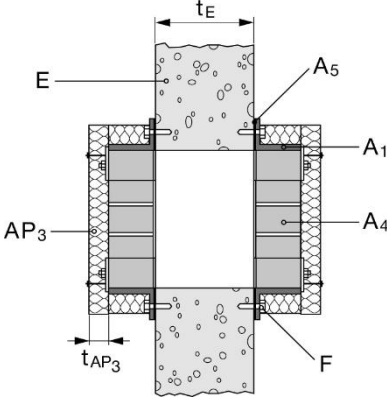
C.5.4.2 Cable penetration - System: CFS-T RR + CFS-T SLF			
Maximum seal size: Ø 205 mm (CFS-T RR-200)			
Construction details (for symbols and abbreviations see Annex A of the ETA):			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	30	250	EI 180
Medium cable group max. Ø 50 mm	30	250	EI 180
Large cable group max. Ø 80 mm	30	250	EI 180

C.5.5 Rigid Walls according to Annex C.1.1 of the ETA – minimum wall thickness 150 mm	
C.5.5.1 Blank seal (no services) - System: CFS-T RRS	
Maximum seal size: Ø 103 mm (CFS-T RRS-100)	Classification
Construction details (for symbols and abbreviations see Annex A of the ETA):	EI 180

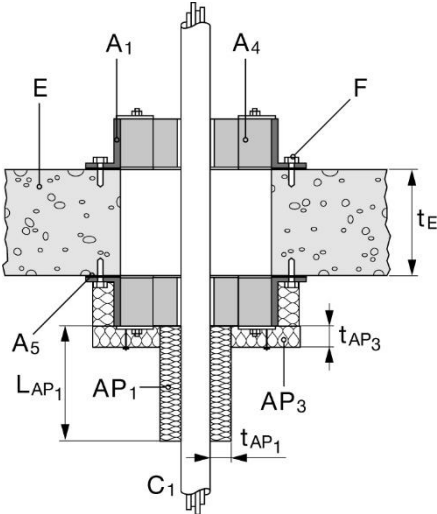
C.5.5.2 Cable penetration - System: CFS-T RRS			
Maximum seal size: Ø 103 mm (CFS-T RRS-100)			
Construction details (for symbols and abbreviations see Annex A of the ETA):			
			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	30	250	EI 180
Medium cable group max. Ø 50 mm	30	250	EI 120 / E 180
Large cable group max. Ø 80 mm	30	250	EI 120 / E180

C.5.6 Rigid Floors according to Annex C.1.1 of the ETA – minimum floor thickness 200 mm			
C.5.6.1 Blank seal (no services) - System: CFS-T RRS			
Maximum seal size: Ø103mm (CFS-T RRS-100)			Classification
Construction details (for symbols and abbreviations see Annex A of the ETA):			EI 180
			

C.5.6.2 Cable penetration - System: CFS-T RRS			
Maximum seal size: Ø 103 mm (CFS-T RRS-100)			
Construction details (for symbols and abbreviations see Annex A of the ETA):			
			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	30	300	EI 180
Medium cable group max. Ø 50 mm	30	300	EI 180
Large cable group max. Ø 80 mm	30	300	EI 180

C.5.7 Rigid Walls according to Annex C.1.1 of the ETA – minimum wall thickness 150 mm	
C.5.7.1 Blank seal (no services) - System: CFS-T RRS + CFS-T SLF	
Maximum seal size: Ø103mm (CFS-T RRS-100)	Classification
Construction details (for symbols and abbreviations see Annex A of the ETA):	EI 180
	

C.5.7.2 Cable penetration - System: CFS-T RRS + CFS-T SLF			
Maximum seal size: Ø 103 mm (CFS-T RRS-100)			
Construction details (for symbols and abbreviations see Annex A of the ETA):			

C.5.8.2 Cable penetration - System: CFS-T RRS + CFS-T SLF			
Maximum seal size: Ø 103 mm (CFS-T RRS-100)			
Construction details (for symbols and abbreviations see Annex A of the ETA): 			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	30	250	EI 180
Medium cable group max. Ø 50 mm	30	250	EI 180
Large cable group max. Ø 80 mm	30	250	EI 180

C.5.9 Rigid Walls according to Annex C.1.1 of the ETA – minimum wall thickness 150 mm

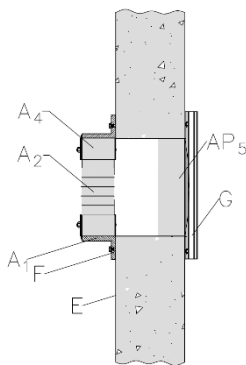
according to Annex C.1.1 of the ETA $\geq 450 \text{ kg/m}^3$

C.5.9.1 Blank seal (no services) - System: CFS-T RR + CFS-T SLF and CFS-PL **single sided - face fixed**

Maximum outer Diameter 200 mm of CFS-T SLF

Classification

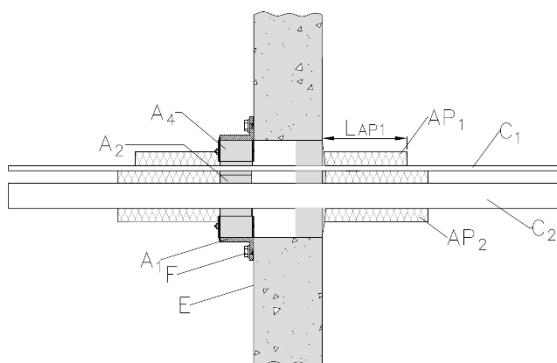
Construction details (for symbols and abbreviations see Annex A of the ETA):



EI 120

C.5.9.2 Cable penetration - System: CFS-T RR + CFS-T SLF and CFS-PL **single sided**

Construction details (for symbols and abbreviations see Annex A of the ETA):



Cable diameter
 C_1 (mm)

Cable insulation
thickness t_{AP1} (mm)

Cable insulation length
 L_{AP1} (mm)

Classification

All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of

(with mineral wool insulation):

cable up to max. $\varnothing$ 80 mm

20

≥ 200

EI 120

(with synthetic rubber insulation):

cable up to max. $\varnothing$ 80 mm

32-39

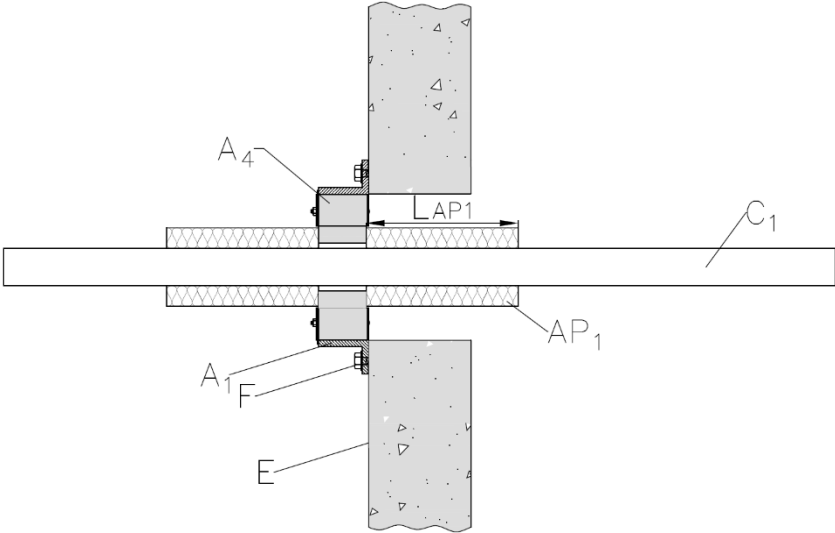
≥ 300

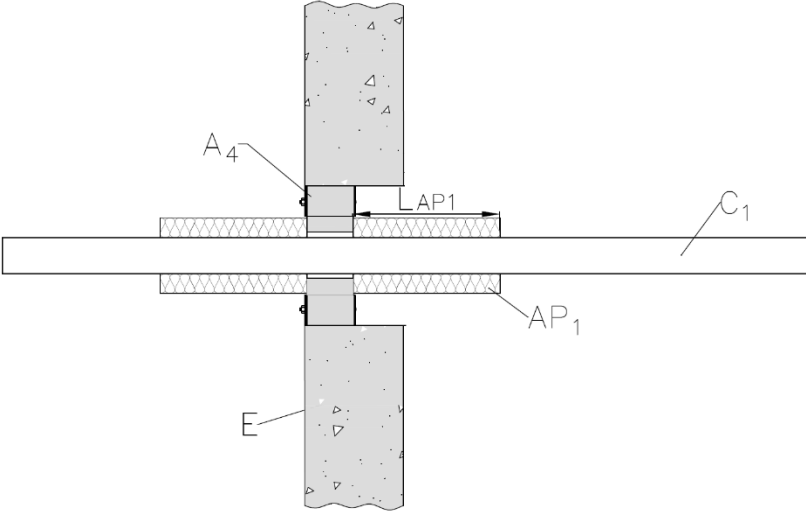
EI 120

C.5.9.3 copper pipe penetration - CFS-T RR + CFS-T SLF and CFS-PL **with mineral wool insulation**

Pipe diameter d_{C2} (mm)	Pipe wall thickness t_{C2} (mm)	Thickness of pipe insulation t_{AP2} (mm)	Length of pipe insulation L_{AP2} (mm)	Arrangement pipe insulation	Classification
≤ 10	$\geq 0,6$	20	≥ 300	LI	EI 120 C/U
≤ 54	$\geq 1,2$	20	≥ 300	LI	EI 120 C/U

C.5.9.4 copper pipe penetration - CFS-T RR + CFS-T SLF and CFS-PL with synthetic rubber insulation					
Pipe diameter d_{C2} (mm)	Pipe wall thickness t_{C2} (mm)	Thickness of pipe insulation t_{AP2} (mm)	Length of pipe insulation L_{AP2} (mm)	Arrangement pipe insulation	Classification
≤ 10	$\geq 0,6$	35	≥ 400	LI	EI 120 C/U
≤ 54	$\geq 1,2$	35	≥ 400	LI	EI 120 C/U

C.5.10 Rigid Walls according to Annex C.1.1 of the ETA – minimum wall thickness 150 mm			
C.5.10.1 Single cable penetration - System: CFS-T RRS + CFS-T SLF single sided – face fixed			
Maximum outer Diameter 100 mm of CFS-T SLF wall density minimum 450 kg/m³			
Construction details (for symbols and abbreviations see Annex A of the ETA):			
			
Cable diameter C_1 (mm)	Cable insulation thickness t_{AP1} (mm)	Cable insulation length L_{AP1} (mm)	Classification
with mineral wool insulation:			
B cable up to 18 mm (1x95mm²)	20	≥ 300	EI 120
E cable up to 23 mm (1x185 mm²)	20	≥ 300	EI 120
D3 cable up to 58 mm (4x185 mm²)	20	≥ 300	EI 120

C.5.10.2 Single cable penetration - System: CFS-T RRS single sided – integrated			
Maximum outer Diameter 100 mm of CFS-T SLF			
Construction details (for symbols and abbreviations see Annex A of the ETA):			
			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
with mineral wool insulation:			
Maximum outer Diameter 100 mm of CFS-T SLF / wall density minimum 450 kg/m ³			
B cable up to 18 mm (1x95mm ²)	20	≥ 300	EI 120
E cable up to 23 mm (1x185 mm ²)	20	≥ 300	EI 120
D1 cable up to 58 mm (4x185 mm ²)	20	≥ 300	EI 120

with mineral wool insulation:			
Maximum outer Diameter 200 mm of CFS-T SLF / wall density minimum 2200 kg/m ³			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
2XS(FL)2Y-2LWL, 1x2500RMS/250 380kV up to 86 mm	30	≥ 300	EI 120
NA2XS(FL)2Y,1x2000RMS/70 64/110 kV up to 110 mm	30	≥ 300	EI 120
2XS(FL)2Y-2LWL,1x2500RMS/250 380 kV up to 143 mm	30	≥ 300	EI 120

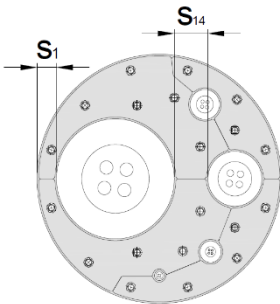
C.6 Penetration seal system Hilti CFS-T RR Vario in rigid walls and floors

according to Annex C.1.1 of the ETA

Maximum distance for first service support: 325 mm.
 Maximum seal size: Ø 304 mm (diameter).
 Minimum distances in mm cable penetration seal:

s_1 = 7,5 (distance between cables and the side seal edge)
 s_{14} = 6,25 (distance between two cables)

Minimum distances in mm (see illustration of distances below):

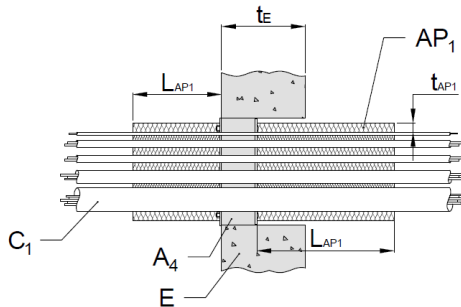
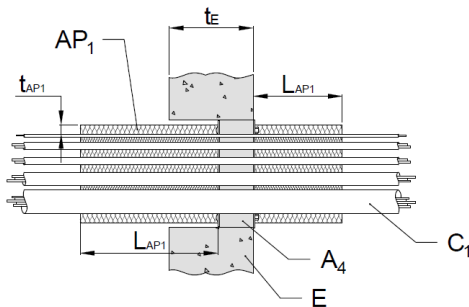


C.6.1 Rigid Walls according to Annex C.1.1 of the ETA – minimum wall thickness 200 mm

C.6.1.1 Cable penetration - System: CFS-T RR Vario

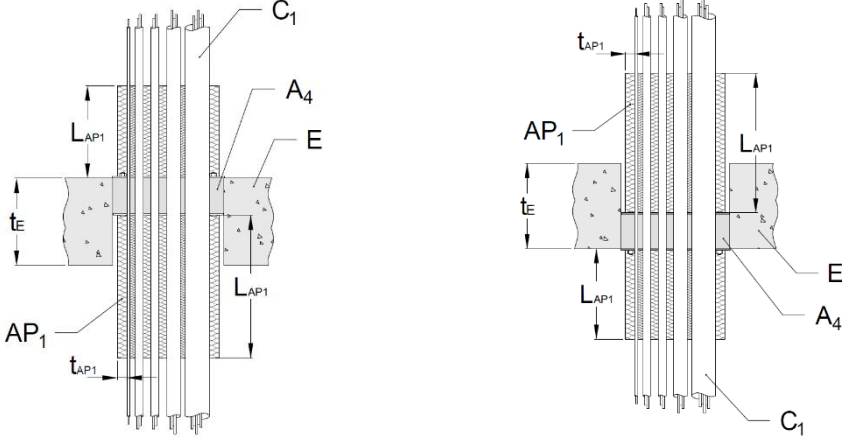
Maximum seal size: Ø 302 mm (CFS-T RR Vario 300)

Construction details (for symbols and abbreviations see Annex A of the ETA):

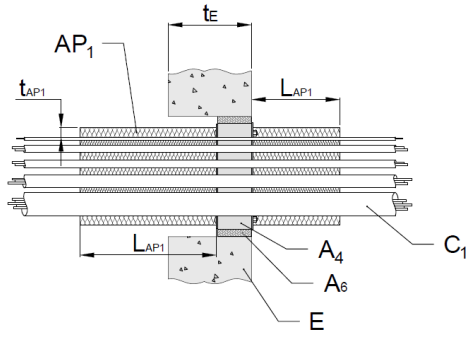
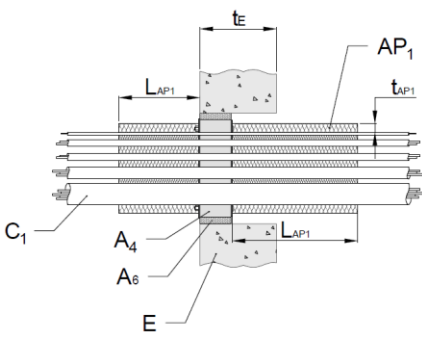


Cable diameter C_1 (mm)	Cable insulation thickness t_{AP1} (mm)	Cable insulation length L_{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	20	300 / 440*	EI 120
Medium cable group max. Ø 50 mm	20	300 / 440*	EI 90 E 120
Large cable group max. Ø 80 mm	20	300 / 440*	EI 90 E 120
Special cable Ø min.80 mm - max.143 mm (SüdKabel GmbH 2XS(FL)2Y- 2LWL 1x2500RMS / 250 380 kV or similar)	20	300 / 440*	EI 90 E 120

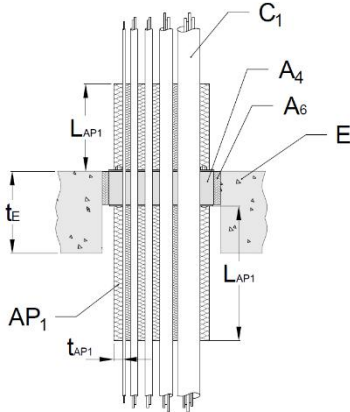
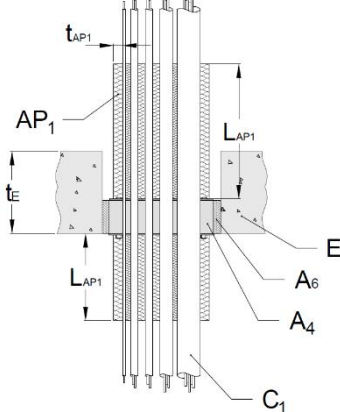
* Please check the section drawings above for the correct length and application side (exposed or unexposed) of the cable insulation.

C.6.2 Rigid Floors according to Annex C.1.1 of the ETA – minimum floor thickness 200 mm			
C.6.2.1 Cable penetration - System: CFS-T RR Vario			
Maximum seal size: Ø 302 mm (CFS-T RR Vario 300)			
Construction details (for symbols and abbreviations see Annex A of the ETA):			
			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	20	300 / 440*	EI 120
Medium cable group max. Ø 50 mm	20	300 / 440*	EI 120
Large cable group max. Ø 80 mm	20	300 / 440*	EI 120
Special cable Ø min.80 mm - max.143 mm (SüdKabel GmbH 2XS(FL)2Y- 2LWL 1x2500RMS / 250 380 kV or similar)	20	300 / 440*	EI 120

* Please check the section drawings above for the correct length and application side (exposed or unexposed) of the cable insulation.

C.6.3 Rigid Walls according to Annex C.1.1 of the ETA – minimum wall thickness 200 mm			
C.6.3.1 Cable penetration - System: CFS-T RR Vario + CFS-T SST			
Maximum seal size: Ø 304 mm (CFS-T RR Vario 300)			
Construction details (for symbols and abbreviations see Annex A of the ETA):			
 			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	20	300 / 440*	EI 120
Medium cable group max. Ø 50 mm	20	300 / 440*	EI 60 E 120
Large cable group max. Ø 80 mm	20	300 / 440*	EI 60 E 120
Special cable Ø min.80 mm - max.143 mm (SüdKabel GmbH 2XS(FL)2Y- 2LWL 1x2500RMS / 250 380 kV or similar)	20	300 / 440*	EI 60 E 120

* Please check the section drawings above for the correct length and application side (exposed or unexposed) of the cable insulation.

C.6.4 Rigid Floors according to Annex C.1.1 of the ETA – minimum floor thickness 200 mm			
C.6.4.1 Cable penetration - System: CFS-T RR Vario + CFS-T SST			
Maximum seal size: Ø 304 mm (CFS-T RR Vario 300)			
Construction details (for symbols and abbreviations see Annex A of the ETA):			
 			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	20	300 / 440*	EI 120
Medium cable group max. Ø 50 mm	20	300 / 440*	EI 60 E 120
Large cable group max. Ø 80 mm	20	300 / 440*	EI 60 E 120
Special cable Ø min.80 mm - max.143 mm (SüdKabel GmbH 2XS(FL)2Y- 2LWL 1x2500RMS / 250 380 kV or similar)	20	300 / 440*	EI 60 E 120

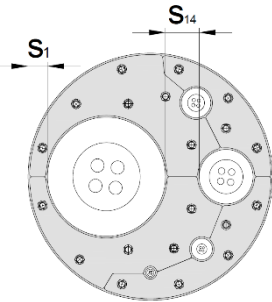
* Please check the section drawings above for the correct length and application side (exposed or unexposed) of the cable insulation.

C.7 Penetration seal system Hilti CFS-T RR Vario (H) in rigid walls and floors

according to Annex C.1.1 of the ETA

Maximum distance for first service support: 325 mm.
Maximum seal size: Ø 302 mm (diameter).
Minimum distances in mm cable penetration seal:
s₁ = 7,5 (distance between cables and the side seal edge)
s₁₄ = 6,25 (distance between two cables)

Minimum distances in mm (see illustration of distances below):

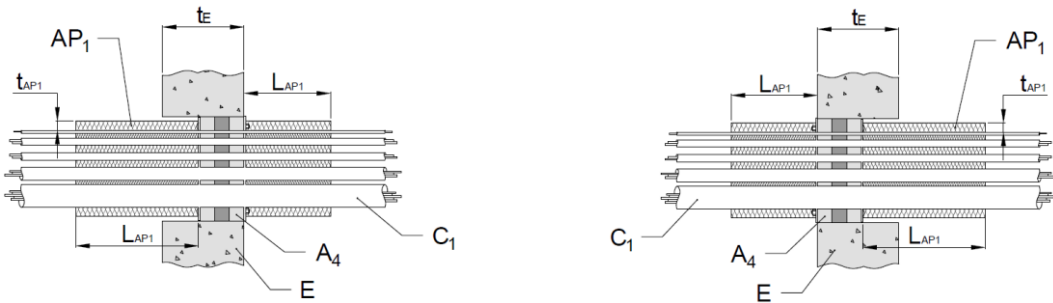


C.7.1 Rigid Walls according to Annex C.1.1 of the ETA – minimum wall thickness 200 mm

C.7.1.1 Cable penetration - System: CFS-T RR Vario (H)

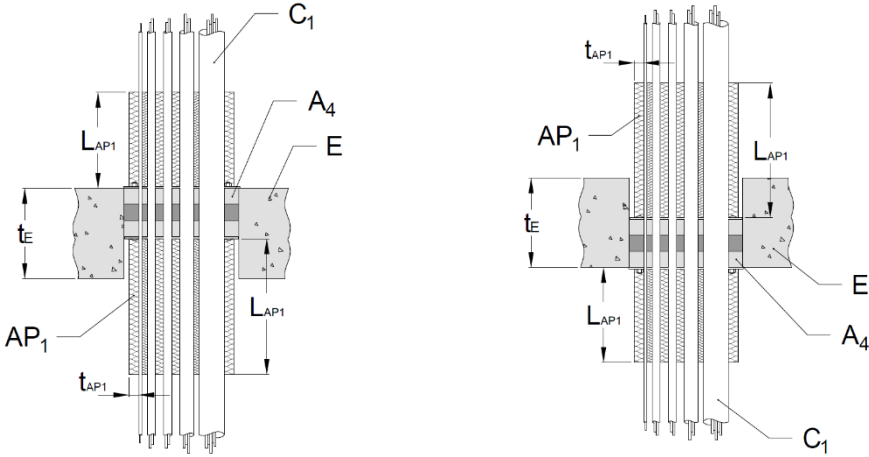
Maximum seal size: Ø 302 mm (CFS-T RR Vario (H) 300)

Construction details (for symbols and abbreviations see Annex A of the ETA):



Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	20	300 / 410*	EI 120
Medium cable group max. Ø 50 mm	20	300 / 410*	EI 120 / 90 E 120
Large cable group max. Ø 80 mm	20	300 / 410*	EI 120 / 90 E 120
Special cable Ø min.80 mm - max.143 mm (SüdKabel GmbH 2XS(FL)2Y- 2LWL 1x2500RMS / 250 380 kV or similar)	20	300 / 410*	EI 120 / 90 E 120

* Please check the section drawings above for the correct length and application side (exposed or unexposed) of the cable insulation.

C.7.2 Rigid Floors according to Annex C.1.1 of the ETA – minimum floor thickness 200 mm			
C.7.2.1 Cable penetration - System: CFS-T RR Vario (H)			
Maximum seal size: Ø 302 mm (CFS-T RR Vario (H) 300)			
Construction details (for symbols and abbreviations see Annex A of the ETA):			
			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	20	300 / 410*	EI 120
Medium cable group max. Ø 50 mm	20	300 / 410*	EI 120
Large cable group max. Ø 80 mm	20	300 / 410*	EI 120
Special cable Ø min.80 mm - max.143 mm (SüdKabel GmbH 2XS(FL)2Y- 2LWL 1x2500RMS / 250 380 kV or similar)	20	300 / 410*	EI 120

* Please check the section drawings above for the correct length and application side (exposed or unexposed) of the cable insulation.

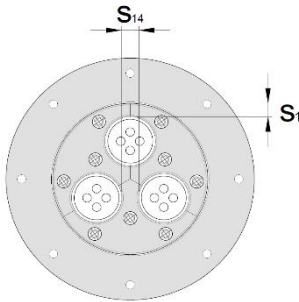
C.8 Penetration seal system Hilti CFS-T RR3 in rigid walls and floors

according to Annex C.1.1 of the ETA

Maximum distance for first service support: 325 mm.
Maximum seal size: Ø 202 mm (diameter).
Minimum distances in mm cable penetration seal:

s_1 = 11 (distance between cables and the side seal edge)
 s_{14} = 9 (distance between two cables)

Minimum distances in mm (see illustration of distances below):

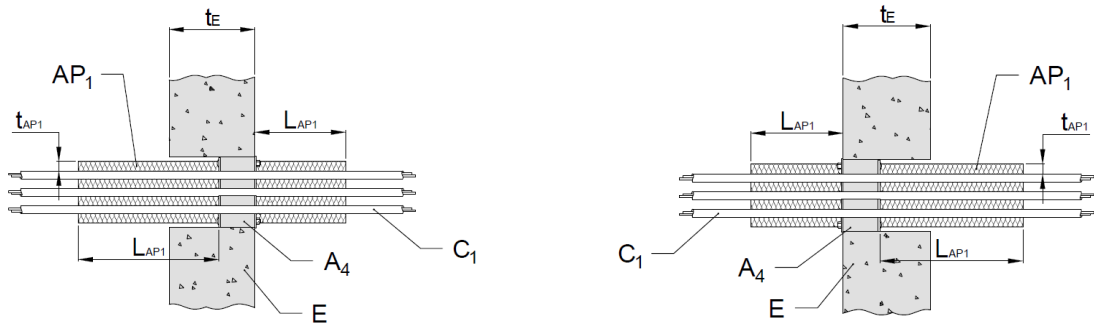


C.8.1 Rigid Walls according to Annex C.1.1 of the ETA – minimum wall thickness 200 mm

C.8.1.1 Cable penetration - System: CFS-T RR3

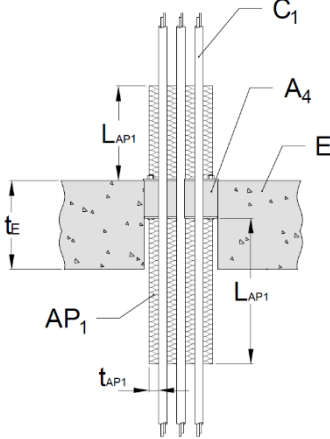
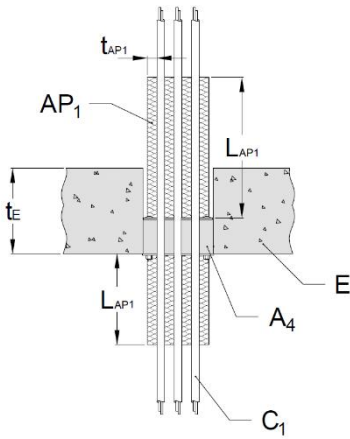
Maximum seal size: Ø 202 mm (CFS-T RR3 200)

Construction details (for symbols and abbreviations see Annex A of the ETA):

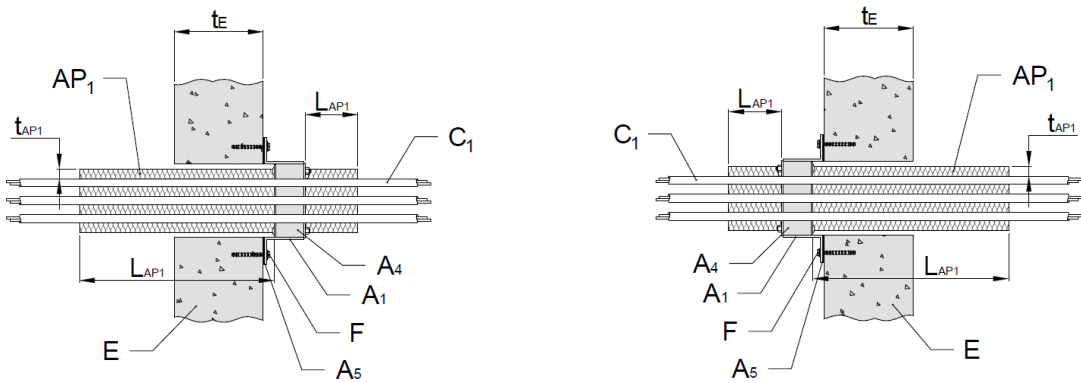


Cable diameter C_1 (mm)	Cable insulation thickness t_{AP1} (mm)	Cable insulation length L_{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	---	---	---
Medium cable group max. Ø 50 mm	20	300 / 440*	EI 120 / 90 E 120
Large cable group max. Ø 80 mm	20	300 / 440*	EI 120

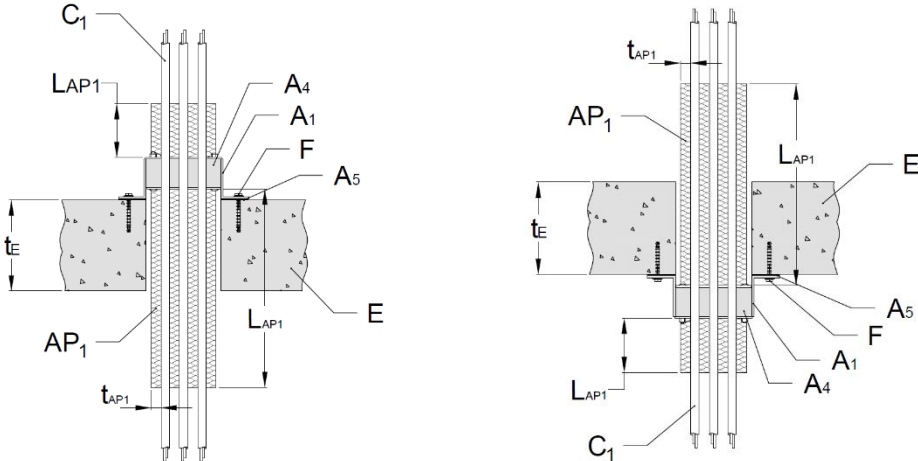
* Please check the section drawings above for the correct length and application side (exposed or unexposed) of the cable insulation.

C.8.2 Rigid Floors according to Annex C.1.1 of the ETA – minimum floor thickness 200 mm			
C.8.2.1 Cable penetration - System: CFS-T RR3			
Maximum seal size: Ø 202 mm (CFS-T RR3 200)			
Construction details (for symbols and abbreviations see Annex A of the ETA):			
 			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	---	---	---
Medium cable group max. Ø 50 mm	20	300 / 440*	EI 120
Large cable group max. Ø 80 mm	20	300 / 440*	EI 120

* Please check the section drawings above for the correct length and application side (exposed or unexposed) of the cable insulation.

C.8.3 Rigid Walls according to Annex C.1.1 of the ETA – minimum wall thickness 200 mm			
C.8.3.1 Cable penetration - System: CFS-T RR3 + CFS-T SLF			
Maximum seal size: Ø 202 mm (CFS-T RR3 200)			
Construction details (for symbols and abbreviations see Annex A of the ETA):			
			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	---	---	---
Medium cable group max. Ø 50 mm	20	220 / 520*	EI 120 / 45
Large cable group max. Ø 80 mm	20	220 / 520*	EI 120

* Please check the section drawings above for the correct length and application side (exposed or unexposed) of the cable insulation.

C.8.4 Rigid Floors according to Annex C.1.1 of the ETA – minimum floor thickness 200 mm			
C.8.4.1 Cable penetration - System: CFS-T RR3 + CFS-T SLF			
Maximum seal size: Ø 202 mm (CFS-T RR3 200)			
Construction details (for symbols and abbreviations see Annex A of the ETA):			
			
Cable diameter C ₁ (mm)	Cable insulation thickness t _{AP1} (mm)	Cable insulation length L _{AP1} (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, except waveguide and non-sheathed cables with a diameter of:			
Small cable group max. Ø 21 mm	---	---	---
Medium cable group max. Ø 50 mm	20	220 / 520*	EI 120 / 30
Large cable group max. Ø 80 mm	20	220 / 520*	EI 120

* Please check the section drawings above for the correct length and application side (exposed or unexposed) of the cable insulation.

ANNEX D - ABBREVIATIONS USED IN DRAWINGS

Abbreviation	Description
A ₁	Hilti Firestop Cable Transit Frame (Sleeve)
A ₂	Hilti Firestop Cable Transit Modules
A ₂ SM	Hilti Firestop Cable Transit Super Modules
A ₃	Hilti Firestop Cable Transit Wedge
A ₄	Hilti Firestop Cable Transit Plug Seal
A ₅	Sealing with Hilti Firestop Acrylic Sealant CFS-S ACR
A ₆	Sealing Strip Hilti CFS-T SST
C ₁	Cable
C ₂	Pipe
d _{C2}	Pipe diameter (nominal outside diameter)
AP ₁	Cable Insulation
AP ₂	Pipe Insulation
AP ₃	Transit Frame Insulation
AP ₄	Hilti Firestop Block CFS-BL
AP ₅	Hilti Firestop Plug CFS-PL
E	Building element (wall, floor)
F	Fixing of the frame (sleeve)
G	Additional support with MQ channel
s ₁	Minimum distance between single penetration seals
t _{C2}	Pipe wall thickness
t _{AP1}	Insulation thickness / cable
t _{AP2}	Insulation thickness / pipe
t _{AP3}	Insulation thickness / transit frame
t _E	Thickness of the building element
L _{AP1}	Length of Cable Insulation
L _{AP2}	Length of Pipe Insulation